

DRAFT
RECOMMENDATION

TC 8/SC 7
(Belgium/France)

SUBMITTED
FOR DIRECT
CIML ONLINE
APPROVAL

New OIML Draft Recommendation

Measuring systems for gaseous fuel

*Draft submitted for
direct CIML online approval
on 2007.04.02.*

Voting closes on 2007.07.02.



ORGANISATION INTERNATIONALE
DE MÉTROLOGIE LÉGALE

INTERNATIONAL ORGANIZATION
OF LEGAL METROLOGY

MEASURING SYSTEMS FOR GASEOUS FUEL
CONTENTS

Foreword

1	Introduction
2	Scope of application
3	Terminology
T.1	The measuring system and its constituents
T.2	Metrological characteristics
T.3	Tests and test conditions
T.4	Electronic or electrical equipment
4	Description
4.1	Components of a measuring system
4.2	Concept of measuring systems
4.3	Flow measurement
5	Units of measurement and abbreviations
5.1	Units of measurement
5.2	Abbreviations
6	Metrological requirements
6.1	Accuracy classes
6.2	Maximum permissible errors (MPEs) for measuring systems
6.3	MPEs for modules
6.4	Other metrological performances of a CVDDs
6.5	MPEs for calculators
6.6	Repeatability error of a metering module
6.7	Endurance of a metering module
6.8	Maximum permissible errors for in service instruments or subsequent verifications
7	Technical requirements for measuring systems
7.1	General
7.2	Metering module
7.3	Converting into volume at base conditions or mass
7.4	Determination of energy
7.5	Marking
7.6	Sealing

8	Technical requirements for meters, metering modules and ancillary devices
8.1	Meter and metering module
8.2	Indicating device
8.3	Printing device
8.4	Memory device
8.5	Associated measuring instruments
8.6	Conversion device
8.7	Calculator
8.8	Calorific value determining device
8.9	Energy conversion device
9	Technical requirements for electronic devices
9.1	General requirements
9.2	Power supply device
9.3	Checking facilities
10	Metrological control
10.1	General
10.2	Type approval
10.3	Initial verification
10.4	Documented provisions, quality systems and routine controls
Annex A	Performance environmental influence tests for electronic measuring systems (Mandatory)
Annex B	Influence tests for type approval for metering modules (Mandatory)
Annex C	Principles of the modular approach and of error calculation (Mandatory/informative)
Annex D	General considerations on gas measuring systems (Informative)
Annex E	Calibration gases (Mandatory/informative)
Annex F	Minimum test quantities for measuring systems and devices (Informative)
Annex G	Conversion of gas mass to volume at base conditions (Informative)
Annex H	Bibliography

Foreword

The International Organization of Legal Metrology (OIML) is a worldwide, intergovernmental organization whose primary aim is to harmonize the regulations and metrological controls applied by the national metrological services, or related organizations, of its Member States. The main categories of OIML publications are:

International Recommendations (OIML R), which are model regulations that establish the metrological characteristics required of certain measuring instruments and which specify methods and equipment for checking their conformity; the OIML Member States shall implement these Recommendations to the greatest possible extent;

International Documents (OIML D), which are informative in nature and intended to improve the work of the metrological services;

International Basic Publications (OIML B), which define the operating rules of the various OIML structures and systems;

International Guides (OIML G), which are informative in nature and which are intended to give guidelines for the application of certain requirements to legal metrology.

OIML Draft Recommendations, Documents and Guides are developed by Technical Committees or Subcommittees which are formed by the Member States. Certain international and regional institutions also participate on a consultation basis. Cooperative agreements are established between the OIML and certain institutions, such as ISO and the IEC, with the objective of avoiding contradictory requirements; consequently, manufacturers and users of measuring instruments, test laboratories, etc. may simultaneously apply OIML publications and those of other institutions.

International Recommendations, Documents and Guides are published in French (F) and English (E) and are subject to periodic revision.

Additionally, the OIML participates in the publication of **Vocabularies (OIML V)** and periodically commissions legal metrology Experts to write **Expert Reports (OIML E)**. Expert Reports are intended to provide information and advice to metrological authorities, and are written solely from the viewpoint of their author, without the involvement of a Technical Committee or Subcommittee, nor that of the CIML. Thus they do not necessarily represent the views of the OIML.

This publication - reference OIML R XXX, edition 200X (E) - was developed by the OIML Technical Subcommittee TC 8/SC 7 *Gas metering*. It was approved for final publication by the International Committee of Legal Metrology in 200X.

OIML Publications may be downloaded from the OIML web site in the form of PDF files. Additional information on OIML Publications may be obtained from the Organization's headquarters:

Bureau International de Métrologie Légale
11, rue Turgot - 75009 Paris - France
Telephone: 33 (0)1 48 78 12 82
Fax: 33 (0)1 42 82 17 27
E-mail: biml@oiml.org
Internet: www.oiml.org

1 Introduction

1.1 Preliminary information on the scope

Traditionally and until now, in many countries, legal metrology was mainly concerned with gas meters in the field of gas metering. However, in general, the price of the transaction for a quantity of gas is not only depending on the volume measured using volume meters subject to metrological control, but also on the metering parameters (installation, gas meter, pressure, temperature) and the nature of the gas. For these reasons, this Recommendation introduces the notion of measuring system.

The national authorities may decide if the legal metrological control is applicable:

1 Only to meters

In this case it is sufficient to refer only to the relevant applicable OIML Recommendations.

2 Only to some individual parts of the measuring system

In this case they should refer only to corresponding requirements applicable to these parts in this Recommendation, with the possibility, as far as the meter is concerned, to refer only to relevant OIML Recommendations without taking into account the conditions of installation for example.

3 To the complete measuring system

In this case they should refer to all the relevant parts of this Recommendation applicable for the type of measuring system and shall decide which types of measuring systems are subject to legal control (energy or mass or volume at base conditions).

1.2 Preliminary information on the approach

This Recommendation uses new concepts for legal metrology such as the concept of “documented provisions” (see definition in T.1.20) and the quadratic combination of maximum permissible errors applicable to modules in order to determine the maximum permissible error of the measuring system. This concept does not “guaranty” that each measurement fulfils the maximum permissible errors but is consistent with the fact that nobody has to pay for a single measurement but with a combination of consecutive measurements in the field of gas measurement, and that the probability that all the elements of the system operate in the worse conditions in the same time is very low.

This approach leads to implement tools that are used in general in the field of uncertainty calculations, but in no case it has to be considered that the errors which are determined in the framework of this document can be considered as uncertainties or as fulfilling all the necessary criteria applicable to uncertainty calculations. This approach must be considered as a conventional one, being a good compromise between a scientific approach and a practical but rigorous approach.

This approach should allow a better idea of the global accuracy of measurements than the result which would result of an arithmetic addition of individual MPEs applicable to the components of the measuring system and of their shift of errors under influence quantities for instance.

1.3 Information on the scopes of OIML TC 8/SC 7 and TC 8/SC8

The scopes of the two subcommittees are respectively:

OIML TC 8/SC 7: Gas metering,

OIML TC 8/SC8: Gas meters.

Basically the work developed at the level of this Recommendation is more dedicated to system integrators and to systems made of modules evaluated separately, where the work developed by OIML TC8/SC 8 is intended to manufacturers developing gas meters in which the functionalities corresponding to these modules may be built in a single unit in general. This Recommendation does not provide any requirement applicable to meters.

2 Scope of application

This Recommendation applies to measuring systems for gaseous fuel:

- with a designed maximum flowrate Q_{\max} equal to or greater than 100 m³/h at base conditions and for operating pressures equal to or greater than 200 kPa (2 bar) absolute,
- not fitted with diaphragm gas meters.

It may apply to very large measuring systems located at the border between two countries as well as to smaller measuring systems, with the exception of measuring systems for compressed natural gas for vehicles (CNG).

However the provisions of this Recommendation may be adapted to other cases.

This Recommendation sets forth the metrological and technical requirements applicable to the measuring systems subject to legal metrology controls.

Different types of measuring systems are considered:

- measuring systems providing indications of volume at base conditions (as defined in this Recommendation) or mass converted from a volume of gas determined at metering or base conditions,
- measuring systems providing directly the mass of gas,
- measuring systems providing indication of energy corresponding to a volume at base conditions or a mass of gas.

The concept of measuring system may involve data and figures provided according to documented provisions. This is often necessary in particular for the determination of energy. In this case the purpose of this RI is to provide members with tools in order to manage energy on a metrological basis (see examples in D.3). It is not intended to prohibit members to use other tools allowing the management of energy (see examples in D.4).

The conversion mass to volume is not in the scope of this Recommendation. However this document is not intended to eliminate this possibility. In such a case appropriate provisions in this Recommendation have to be adapted. Annex G gives information on this type of conversion.

This Recommendation also provides the way the measuring systems are approved and verified. The requirements for measuring systems are complementary to those applicable only to meters as provided in relevant OIML Recommendations (R 6, R 32 and R 137-1).

3 Terminology

The terminology used in this Recommendation conforms to the International Vocabulary and general Terms in metrology (VIM) and the Vocabulary of Legal Metrology (VLM-2000). For the purposes of this Recommendation, the following definitions apply.

Note: Those terminologies shall be considered as part of this Recommendation.

T.1 The measuring system and its constituents

T.1.1 Meter

An instrument intended to measure, memorise and display the volume or mass of gas passing through the flow measuring device at metering conditions.

Note: The display may be a remote indicating device.

T.1.2 Flow measuring device

A part of the meter converting the volume or mass flow of the gas to be measured into signals for the calculator. It includes the sensor and the measuring transducer.

T.1.2.1 Sensor (VIM 4.14)

An element of a measuring instrument or measuring chain that is directly affected by the measurand.

T.1.2.2 Measuring transducer (VIM 4.3)

A device that provides an output quantity having a determined relationship to the input quantity.

T.1.3 Calculator

Part of the measuring system that receives the output signals from the flow measuring device(s) or from an other calculator and possibly from the associated measuring instruments, transforms them, and, if appropriate, stores in memory the results until they are used. In addition, the calculator may be capable of transmitting and receiving data from peripheral equipment.

Note: A measuring system may have one, two or more calculators, for instance a mechanical one elaborating the volume at metering condition and transmitting the value to a mechanical indicating device, an electronic one elaborating also the volume at metering condition, associated to an electronic indicating device, and another one to elaborate the converted value.

T.1.4 Indicating device (VIM 4.12 adapted)

A part of a measuring instrument that displays the measurement results

T.1.5 Ancillary device

A device, other than the main indicating device, connected to a calculator, intended to perform a particular function, directly involved in elaborating, transmitting or displaying measurement results.

Main ancillary devices are:

- repeating indicating device,
- printing device,
- memory device,
- totalizing indicating device,
- conversion device.

Notes: 1 An ancillary device may or may not be subject to legal metrology control according to its function in the measuring system or to national regulations.

2 An ancillary device may be integrated into the calculator, into the meter, or constitutes peripheral equipment linked to the calculator by means of an interface.

T.1.6 Additional device

An element or device, other than ancillary, required to ensure correct measurement or intended to facilitate the measuring operations, or which could in any way affect the measurement.

Examples of additional devices are:

- filter,
- flow conditioning device,
- branch or by-pass line,
- valves,
- pressure reduction devices located upstream or downstream the meter,
- sampling systems,
- piping.

T.1.7 Measuring system

A system which comprises the metering module (see T.1.8), and all the ancillary devices and additional devices and when appropriate, a documented provisions system ensuring the quality and the traceability of data.

T.1.8 Metering module

The subassembly of a measuring system which corresponds to the meter(s) itself (themselves), associated where applicable with an additional calculator with a correction and an indicating device, and to all other parts of the gas circuit of the measuring system (in particular additional devices).

T.1.9 Associated measuring instrument

An instrument for measuring certain measurands which are characteristic of the gas (temperature, pressure, calorific value...) and which are used by the calculator with a view to making a correction and/or a conversion.

T.1.10 Correction factor (adapted from VIM 3.16)

A numerical factor (single constant or coming from a mathematical function “ $f(q)$ ”) by which the uncorrected result is multiplied to compensate for the estimated systematic error.

T.1.11 Adjustment and correction devices

T.1.11.1 Adjustment device

A device incorporated in the meter that only allows shifting of the relative error curve generally parallel to itself, with a view to bringing errors within the maximum permissible errors and to set the weighted mean error (see T.2.20) at minimum.

T.1.11.2 Correction device

A device connected to or incorporated in the meter/and or a calculator for automatically correcting the volume at metering conditions, by taking into account the flowrate and/or the characteristics of the gas to be measured (temperature, pressure, gas composition, etc...) and pre-established calibration curves.

Note: The characteristics of the gas may either be measured using associated measuring instruments, or stored in a memory in the instrument.

T.1.12 Conversion device

Notes: 1 In this Recommendation the wording "conversion device" covers conversion devices as such, as well as the conversion function in a calculator.

2 A calculator, a correction device and a conversion device may be combined in a single unit.

T.1.12.1 Volume conversion device

A device which automatically converts the volume measured at metering conditions into a volume at base conditions or into a mass by taking into account the gas characteristics (i.e. pressure, temperature, composition, density) measured using associated measuring instruments or stored in a memory.

The quotient of the volume at base conditions or of the mass to the volume at metering conditions is referred to as "conversion factor".

T.1.12.2 Energy conversion device

A device which automatically multiplies the volume at base conditions or the mass by the representative calorific value of the gas.

T.1.13 Metering conditions

The conditions of the gas at which the quantity is measured at the point of measurement (temperature and pressure of the measured gas).

T.1.14 Base conditions

Specified conditions to which the measured quantities of gas are converted.

Note: The terms "reference conditions" are frequently used instead of "base conditions".

T.1.15 (Gross) Calorific value

The amount of heat which would be released by the complete combustion in air of a specified quantity of gas, in such a way that the pressure at which the reaction takes place remains constant, and all the products of combustion are returned to the same specified temperature as that of the reactants, all of these products being in the gaseous state except for water formed by combustion, which is condensed to the liquid state at this specified temperature [adapted from ISO 6976:1995(E), page 2].

Notes: 1 In the following parts of this Recommendation, calorific value is used for gross calorific value.

2 The condensation enthalpy and combustion enthalpy depend directly upon the temperature and pressure; consequently the energy at base conditions is considered.

3 The calorific value should be determined on a mass or volumetric basis.

T.1.16 Representative calorific value

An individual calorific value or a combination of calorific values that is considered to be, according to the constitution of the measuring system, the most appropriate calorific value to be associated with the metered quantity in order to calculate the energy.

T.1.17 Calorific value determining device (CVDD)

An associated measuring instrument for obtaining the calorific value of gas.

T.1.18 Audit trail

A set of electronic and/or paper records that provide for a complete examination of measured variables, parameters setting and calculation results to check the accuracy of a measurement and any necessary corrections.

Note: The required records may include: volumes at metering conditions, pressures, temperatures, and calorific values, conversion equation specification and parameters, volumes and energy at base conditions, calibration datum, and alarm logs.

T.1.19 Secured communication

A communication, physical or not, between elements of a measuring system ensuring that information transferred from one of these elements to an other one may not be tampered with by the user, by external influences or by fault of the system.

Note: This ensuring is provided by sealing devices and/or checking facilities.

T.1.20 Documented provisions

Provisions established by the user of a measuring system in order to give confidence to the National Authority that operations are performed according to the metrological expectation when they are not performed using associated measuring instruments subject to control and/or secured communications.

Note: Documented provisions may be part of a quality assurance system.

T.1.21 Compressibility factor

A parameter which indicates the deviation from the ideal gas (see ISO 12213-1).

Note: In general in this Recommendation the ratio Z/Z_b of compressibility factors respectively at metering and base conditions is used.

T.1.22 Nominal operating conditions

Normal, average or typical conditions of use of a measuring system or a device provided by the manufacturer.

T.1.23 Principal measurands

The volume at metering conditions, the volume at base conditions, the mass or the energy.

T.2 Metrological characteristics

T.2.1 Primary indication(s)

Indication(s) (displayed, printed or memorised) which is (are) subject to legal metrology control.

Note: Indications other than primary indications are commonly referred to as secondary indications.

T.2.2 Uncertainty of measurement (VIM 3.9)

Parameter, associated with the result of a measurement that characterises the dispersion of the values that could reasonably be attributed to the measurand.

T.2.3 Conventional true value (of a quantity) (VIM 1.20)

Value attributed to a particular quantity and accepted, sometimes by convention, as having an uncertainty appropriate for a given purpose.

T.2.4 (absolute) Error of measurement (VIM 3.10)

Result of a measurement minus a true value of the measurand.

Note: Since a true value cannot be determined, in practice a conventional true value is used.

T.2.5 Relative error (VIM 3.12)

Error of measurement divided by a true value of the measurand.

T.2.6 Maximum permissible error (MPE) (adapted from VIM 5.21)

The extreme values permitted by this Recommendation for an error.

T.2.7 Traceability of a measurement (VIM 6.10)

Property of the result of a measurement or the value of a standard whereby it can be related to stated references, usually national or international standards, through an unbroken chain of comparisons all having stated uncertainties.

T.2.8 Specified measuring ranges

A set of values of measurands or quantities characteristic of the gas for which the error is intended to lie within the limits specified in this Recommendation. In general the upper and lower limits of the specified measuring range are called maximum value and minimum value, respectively (for example: maximum flowrate 2000 m³/h, minimum flowrate 50 m³/h) .

- Notes:
- 1 This definition applies to the measuring system and also to elements that compose the measuring system.
 - 2 Main measurands or quantities characteristic for the metering module are flowrate, pressure or temperature of the gas.
 - 3 A conversion device has a specified measuring range for each quantity that it processes.

T.2.9 Maximum flowrate of the measuring system Q_{\max}

The flowrate equal to the sum of the flowrates of all the meters in parallel branches (where appropriate) forming the system when one of these meters reaches its maximum flowrate under the specified conditions of use, all meters being in use.

T.2.10 Minimum flowrate of the measuring system Q_{\min}

The flowrate equal to or greater than the smallest “minimum flowrate” of the individual meters.

T.2.11 Minimum measured quantity

The smallest quantity for which the measurement is metrologically acceptable for that system.

Note: A measuring system has a minimum measured quantity for each principal measurand it processes (volumes, mass or energy).

T.2.12 Minimum specified quantity deviation

The positive maximum permissible error for a minimum measured quantity of a measuring system or a metering module.

T.2.13 Repeatability error (VIM 3.6 adapted)

For the purpose of this Recommendation, the difference between the largest and the smallest results of successive measurements of a same quantity carried out under the same conditions.

T.2.14 Intrinsic error

The error determined under reference conditions.

T.2.15 Initial intrinsic error

The intrinsic error as determined prior to all performance tests.

T.2.16 Fault

The difference between the error of indication and the intrinsic error of a measuring system or of its constituent elements.

T.2.17 Significant fault

T.2.17.1 For the principal measurands (volumes, mass or energy)

A fault, the magnitude of which is greater than one tenth of the magnitude of the maximum permissible error for the relevant measurand. However whatever is the measured quantity:

- faults greater than one tenth of the magnitude of the maximum permissible error corresponding to a quantity equal to one minute at Q_{\max} are always considered as significant,
- faults smaller than the relevant minimum specified quantity deviation are never considered as significant.

Notes: 1 For the principal measurands this concept applies only to the electronic parts of the measuring system (in general the calculator) but not to the meter as such. Meters shall be tested and assessed according to the specific applicable OIML International Recommendations.

2 The significant fault for a calculator is calculated on the basis of the maximum permissible error applicable to the principal measurand and not on the basis of the maximum permissible error applicable to the calculator.

3 When a device is used for measuring two or more principal measurands (a calculator for example), it has a significant fault for each measurand.

T.2.17.2 For associated measuring instruments other than CVDDs

A fault, the magnitude of which is greater than half of the magnitude of the maximum permissible error for the relevant measurand. However a fault, the magnitude of which is smaller than 2 scale intervals of the associated measuring instrument is never considered as a significant fault.

Note: For associated measuring instruments other than CVDDs this concept applies to the whole associated measuring instrument or only to the electronic part as well, according to what is subject to the test.

T.2.17.3 For CVDDs

A fault, the magnitude of which is greater than one fifth of the magnitude of the maximum permissible error for the calorific value. However a fault, the magnitude of which is smaller than 2 scale intervals of the CVDD is never considered as a significant fault.

Note: For CVDDs this concept applies to the whole device.

T.2.17.4 The following faults are not considered as significant:

- faults resulting from simultaneous causes independent from each other within the instrument itself or within its checking facility;
- temporary faults resulting from momentary indication variations, but which can not be interpreted, stored or transmitted as measuring results.

T.2.18 Drift (VIM 5.16)

A slow change of a metrological characteristic of a measuring instrument.

T.2.19 Installation effect

Any difference in performance of the metering module arising between the calibration under ideal conditions and actual conditions of use. This difference may be caused by different flow conditions due to velocity profile, perturbations or by different working regimes (pulsation, intermittent flow, alternating flow, vibrations...).

T.2.20 Weighted mean error (WME)

A weighted combination of errors of a meter or a metering module. The WME is used to adjust the error curve as close as possible to zero. The WME is calculated as follows:

$$WME = \frac{\sum_{i=1}^n ki \times Ei}{\sum_{i=1}^n ki}$$

Where:

- n greater than or equal to 6 being the number of measurements i performed at different flowrates Q_i ,
- ki being the weighting factors,
- Ei being the error at the flowrate Q_i .

For each flowrate, $ki = Q_i/Q_{max}$, except for $Q_i = Q_{max}$ for which the weighting factor is equal to 0.4.

Note: When the specified measuring range of a metering module including only one meter is known beforehand and when this range is smaller than the maximum specified measuring range of the meter, it is recommended to determine the WME and adjust the meter over the actual operating range only and update the markings accordingly.

T.2.21 Durability

The capability of an electronic part of the measuring system to keep its performance characteristics over a period of use.

T.2.22 Adjustment interval for a calorific value determining device

The time interval or number of measurements between two necessary adjustments of a calorific value determining device.

T.3 Tests and test conditions

T.3.1 Influence quantity (VIM 2.7)

A quantity that is not the measurand but that affects the result of the measurement.

T.3.2 Influence factor

An influence quantity having a value within the rated operating conditions of the measuring system as specified in the present International Recommendation.

T.3.3 Disturbance

An influence quantity outside the specified rated operating conditions of the measuring system.

Note: An influence quantity is a disturbance if for that influence quantity the rated operating conditions are not specified.

T.3.4 Rated operating conditions (adapted from VIM 5.5)

Conditions of use giving the range of values of influence quantities for which the metrological characteristics are intended to be within the maximum permissible errors.

T.3.5 Reference conditions (adapted from VIM 5.7)

A set of reference values or reference ranges of influence factors prescribed for testing the performances of a measuring system or a device or for intercomparisons of the results of measurements.

T.3.6 Performance test

A test intended to verify whether the measuring equipment under test (EUT) is capable of accomplishing its intended functions.

T.3.7 Endurance test

A test intended to verify whether the metering module is able to maintain its performance characteristics over a period of use.

T.4 Electronic or electrical equipment

T.4.1 Electronic device

A device employing electronic sub-assemblies and performing a specific function. Electronic devices are usually manufactured as separate units and are capable of being tested independently.

Notes: 1 The electronic parts of CVDDs are not tested separately.

2 A measuring system including at least one electronic device subject to legal control is called an electronic measuring system.

T.4.2 Checking facility

A facility that is incorporated in a measuring system and which enables significant faults to be detected and acted upon.

Note: The checking of a transmission device aims at verifying that all the information which is transmitted (and only that information) is fully received by the receiving equipment.

T.4.3 Automatic checking facility

A checking facility that operates without the intervention of an operator.

T.4.4 Permanent automatic checking facility (type P)

An automatic checking facility operating continuously during the entire measurement operation.

T.4.5 Intermittent automatic checking facility (Type I)

An automatic checking facility intervening at certain time or quantity intervals.

T.4.6 Non automatic checking facility (Type N)

A checking facility that requires the intervention of an operator.

4 Description

As a general rule according to the maximum flowrate of a measuring system as well as technical and economical considerations, the National Authorities may impose:

- the accuracy class;
- the type of conversion (see 7.3.2);
- the components to be included in the measuring system. Subclause E.3.1 provides suggestions for this purpose.

4.1 Components of a measuring system

4.1.1 A meter itself is not a measuring system or a metering module.

A measuring system may include elements of the following non exhaustive list:

- meter(s) or metering module;
- checking facilities;
- metrological seals;
- conversion devices; (* if applicable)
- calorific value determining device; (* if applicable)
- memory or printing device and automatic chronological recorder; (* according to national regulation)
- switching equipment to select the appropriate number of meter lines corresponding to the real load of the station and used to assure that any meter in service is measuring flows between its Q_{\min} and Q_{\max} ; (*)
- gas sampling extraction and conditioning system; (* if applicable)
- provision for the calibration of the calorific value determining device including calibration standards; (* if applicable)
- isolating valves; (**)
- additional piping and fittings; (**)
- filter and separator; (**)

- gas pre-heating equipment; (**)
 - equipment to reduce the noise level; (**)
 - flow and pressure control equipment for the station or the metering line; (**)
 - equipment to prevent the formation of hydrates and ice; (**)
 - equipment to absorb vibrations and pulsations; (**)
 - flow profile conditioning device; (**)
 - other components; (**)
 - documented provisions and quality assurance systems. (***)
- * is always part of the measuring system when present
- ** is part of the measuring system when there is a risk it influences the performance of the measuring system
- *** is part of the measuring system when necessary to ensure the integrity and/or the correct operation of the measuring system

4.1.2 If several meters and/or flow measuring devices are intended for a single measurement operation, these meters are considered to be included in the same metering module or measuring system.

If several meters and/or flow measuring devices intended for separate measuring operations (different contracts) do have elements in common (calculator, filters, conversion device, etc.), each meter and/or flow measuring device is considered to make up, together with the common elements, one metering module or measuring system.

4.2 Concept of measuring systems

According to the way relevant characteristics of the gas are collected a measuring system may consist of (see E.1):

- 1 Separate modules (metering module, conversion device, calorific value determining device...) which fulfils the requirements for each module and whose modules are connected with secured communications ensuring reliable transmissions of data.
- 2 Separate modules which fulfil the requirements for each module but whose modules are not connected with secured communications ensuring reliable transmissions of data.
In this case documented provisions shall ensure the traceability of data used for the determination of the corresponding measurands.
- 3 Separate modules which fulfil the requirements for each present module and the taking into consideration of data that are not measured (for instance pressure of the gas in the case of converted volume) or that are not locally measured (for instance calorific value of the gas in case of remote determination).
In this case documented provisions shall ensure:
 - the representativeness of the data taken into account, and
 - the traceability of data used for the determination of the corresponding measurands.

Combination of cases 2 and 3 is possible.

The legal authority may decide that the metrological control applies to each type of here-above measuring systems or only applies to certain types.

4.3 Flow measurement

Several different principles of physics may be used to determine the gas quantities (see E.2).

5 Units of measurement and abbreviations

5.1 Units of measurement

The volume shall be indicated in cubic meters. The mass shall be indicated in tonnes or kilograms. The energy shall be indicated in joules and/or kilowatt-hours. The calorific value shall be indicated in a here-above unit of energy per unit of mass or volume at base conditions. For measurements provided by other associated measuring instruments, one shall refer to the list of SI units.

5.2 Abbreviations

- For flowrates:
 - Q_{\min} : minimum flowrate
 - Q_{\max} : maximum flowrate
- For ambient temperature:
 - $T_{\text{am.min}}$: minimum value of the range
 - $T_{\text{am.max}}$: maximum value of the range
- For gas temperature:
 - T_{\min} : minimum value of the range
 - T_{\max} : maximum value of the range
- For gas pressure:
 - P_{\min} : minimum value of the range
 - P_{\max} : maximum value of the range
- For supply electricity:
 - U_{nom} : nominal value for supply voltage
 - F_{nom} : nominal value of supply frequency
- WME: weighted mean error
- MPE: maximum permissible error
- CV: calorific value (symbol H_s)
- CVDD: calorific value determining device
- MMQ: minimum measured quantity for volumes or mass
- MMQe :minimum measured quantity for energy
- E min: minimum specified quantity deviation

6 Metrological requirements

6.1 Accuracy classes

Measuring systems are classified into three accuracy classes A, B, C.

6.2 Maximum permissible errors (MPEs) for measuring systems

6.2.1 The maximum permissible relative errors, positive or negative, for measuring systems are specified in Table 1. These values are applicable for type approval and for initial verification.

TABLE 1
MPEs for measuring systems

Maximum permissible errors on determining ...	Accuracy class A	Accuracy class B	Accuracy class C
Energy	± 1.0 %	± 2.0 %	± 3.0 %
Converted volume, converted mass or direct mass	± 0.9 %	± 1.5 %	± 2.0 %

6.2.2 However the magnitude of the maximum permissible error (after calculation as an absolute value) shall be equal to or greater than the minimum specified quantity deviation E_{\min} which is given by the formula :

$$E_{\min} = 2 \times MMQ \times MPE$$

Where:

MMQ is the minimum measured quantity for the relevant measurand,

MPE is the relevant value in the table.

6.3 MPEs for modules

6.3.1 General

6.3.1.1 The maximum permissible errors, positive or negative, for modules (parts or functions as stated in the here under table 2) are specified in Table 2. These values are applicable at type approval and at initial verification.

TABLE 2
MPEs for modules

Maximum permissible errors on...	Accuracy class A	Accuracy class B	Accuracy class C
Measuring volume at metering conditions (see 6.3.2)	± 0.70 %	± 1.20 %	± 1.50 %
Converting in volume at base conditions or in mass (see 6.3.3)	± 0.50 %	± 1.00 %	± 1.50 %
Calorific value measurement (only CVDD) (see 6.3.4)	± 0.50 %	± 1.00 %	± 1.00 %
Representative Calorific value determination (see 6.3.4)	± 0.60 %	± 1.25 %	± 2.00 %
Converting in energy (see 6.3.4)	see 6.5	see 6.5	see 6.5

6.3.1.2 However for volume at metering conditions the magnitude of the maximum permissible errors (after calculation as an absolute value) shall be equal to or greater than the minimum specified quantity deviation E_{min} which is given by the formula :

$$E_{min} = 2 \times MMQ \times MPE$$

Where:

MMQ is the minimum measured quantity

MPE is the relevant value in the table.

6.3.1.3 Moreover when the conformity to table 1 cannot be verified directly, the conformity of the measuring system is assessed by calculation. By convention and where applicable, the global maximum permissible error of a measuring system is equal to the square root of the sum of the squares of the maximum permissible errors of the following modules (see Annex C for an example):

- metering module (measuring the quantity at metering conditions),
- converting this quantity in volume at base conditions or in mass,
- CV determination.

6.3.2 Measuring volume at metering conditions

Maximum permissible errors on measuring volume at metering conditions apply to type approval or initial verification where:

- the meter is corrected (or WME set at its minimum) where necessary or applicable,
- the meter is adjusted at nominal operating conditions,
- installation effects are taken into account (see Annex B).

When a metering module is subject to a first stage verification (before verification on site or if this verification is considered sufficient by the authority-see 10.3) MPEs for this verification are calculated according to the formula in B.6.1.

Note: The MPEs applicable to metering modules, specified for volume or mass measurements may be smaller than the corresponding values specified in other Recommendations applicable to meters (see also 7.2.1.1). As a consequence, a correction device added to the meter may be necessary.

6.3.3 Converting in volume at base conditions or in mass

Maximum permissible errors on converting in volume at base conditions or in mass may be verified either on the basis of a modular approach as stated in 6.3.3.1 or 6.3.3.2, or on the basis of a global approach as stated in 6.3.3.3. The three approaches are considered as being equivalent and conversion devices assessed according to 6.3.3.1 or 6.3.3.2 are considered as fulfilling the global requirements for conversion devices in 6.3.3.3.

In the three cases when some characteristics of the gas are not measured using associated measuring instruments (pressure or compressibility factor in particular), this shall be taken into consideration in order to determine that the requirement on the conversion in table 2 is fulfilled.

Where necessary, the conventional true compressibility factor shall be calculated according to ISO 12 213.

6.3.3.1 First modular approach

In the first modular approach, the associated measuring instruments and the calculations are verified separately. Each associated measuring instrument is verified globally (table 3-1), using the indication available on the conversion device. The verification of calculation consists in verifying the calculation concerning each characteristic quantity of the gas (6.3.3.1.1) and the calculation for the conversion (6.5).

The associated measuring instruments are approved for or with a type or some types of conversion devices in order to ensure the compatibility of the association.

Conversion devices which satisfy provisions in 6.3.3.1.1, 6.3.3.1.2 and 6.5 are supposed to fulfil the corresponding requirement laid down in Table 2 (taking into consideration the general statement in introduction of 6.3.3 if only temperature is measured).

6.3.3.1.1 The MPEs applicable to the relevant associated measuring instruments are laid down in Table 3-1. These values are applicable at type approval and at initial verification.

TABLE 3-1**MPEs for associated measuring instruments other than CVDDs**

Maximum permissible errors on	Accuracy class A	Accuracy class B	Accuracy class C
Temperature	$\pm 0.5 \text{ }^{\circ}\text{C}$	$\pm 0.5 \text{ }^{\circ}\text{C}$	$\pm 1 \text{ }^{\circ}\text{C}$
Pressure	$\pm 0.2 \%$	$\pm 0.5 \%$	$\pm 1 \%$
Density	$\pm 0.35 \%$	$\pm 0.7 \%$	$\pm 1 \%$
Compressibility factor	$\pm 0.3 \%$	$\pm 0.3 \%$	$\pm 0.5 \%$

6.3.3.1.2 The maximum permissible errors on the calculation of each characteristic quantity of the gas, positive or negative, are equal to one fifth of the relevant value specified in Table 3-1.

6.3.3.2 Second modular approach

In the second modular approach, the associated measuring instruments and the calculations are also verified separately, but each associated measuring instrument is verified globally (table 3-1), using the indication available on the associated measuring instruments itself. This indication shall correspond to the one which is directly processed for the converted volume. Then the verification of calculation consists only in verifying the calculation for the conversion (6.5).

In this case the associated measuring instruments deliver a digital signal. They may be considered as interchangeable provided the type examination certificate provides all the necessary conditions of compatibility with the calculator of the conversion device.

Conversion devices using associated measuring instruments delivering a digital signal directly processed for the conversion and which satisfy provisions in 6.3.3.1.2 and which satisfy 6.5 are supposed to fulfil the corresponding requirement laid down in Table 2 (taking into consideration the general statement in introduction of 6.3.3 if only temperature is measured).

These values are applicable at type approval and at initial verification.

6.3.3.3 Global approach

In this approach the conversion device is tested as a whole, calculator associated with the associated measuring instruments.

Conversion devices which satisfy provisions in table 3-2 are supposed to fulfil the corresponding requirement laid down in Table 2 (taking into consideration the general statement in introduction of 6.3.3 if only temperature is measured).

Table 3-2**MPEs on volume at base conditions or mass for conversion devices tested as a whole**

Test conditions and types of conversion	Accuracy class A	Accuracy class B	Accuracy class C
Tests in reference conditions for all types of conversion	0.3 %	0.5 %	0.7 %
Tests in rated operating conditions for conversion devices performing as a function only of temperature	- (not relevant)	0.7 %	1.0 %
Tests in rated operating conditions for other conversion devices	0.5 %	1.0 %	1.5 %

6.3.4 Converting in energy/determination of the calorific value

In order to determine the errors on the calorific value (CV), the conventional true CV shall be calculated according to ISO 69 76.

6.3.4.1 Converting in energy results of the multiplication of the mass or converted volume by the representative calorific value.

The MPEs on the multiplication are those given in 6.5. As these MPEs are small comparing to MPEs applicable to the determination of CV, they need not to be taken into account in the final calculation of error on energy.

6.3.4.2 According to the description of possible measuring systems laid down in 4.2, the determination of the CV may necessitate documented provisions. This is the case when the CV is not determined locally (at the same place than the metering module) and/or when the CV is not continuously measured and associated with the metered quantity without a shift in time.

As a consequence and by definition the error in converting in energy results of the following possible components:

- the error on the calorific value determining device (CVDD),
- the (expanded) uncertainty resulting of the fact that the CV is not perfectly stable and is not continuously measured UC,
- the (expanded) uncertainty resulting of the fact that the CV is not associated to the metered quantity without a shift in time, UT,
- the (expanded) uncertainty resulting of the fact that the CV is not locally determined, UL,
- other possible components of uncertainties, UO.

The estimation of expanded uncertainties should be made according to the Guide to the expression of uncertainty in measurement (1995 edition). The way these components are determined and combined in order to calculate the error on converting in energy is laid down in 7.4.2.

6.3.4.3 For class A and B, the MPEs on the determination of the representative CV are slightly larger than the maximum MPEs for a CVDD. This is necessary at least because of the component of uncertainty U_c. Practical consequences of figures of table 2 are in general:

- a class A measuring system involves one (or more for a better accuracy) local class A CVDD(s),
- a class B measuring system involves either one or more class A CVDD(s) in general associated with relevant documented provisions or one or more local class B CVDD(s),
- a class C measuring system involves one or more class A or class B CVDD(s) associated with relevant documented provisions.

6.4 Other metrological performances of a CVDD

Requirements from 6.4.1 through **Erreur ! Source du renvoi introuvable.** and 6.4.9 apply to all types of CVDDs. In addition provisions from 6.4.7 through 6.4.8 give additional requirements for specific types of CVDDs.

6.4.1 General requirement

The complete CVDD (not only the electronic part) shall fulfil the general requirements specified in 9.1.

6.4.2 Repeatability

The repeatability error (as defined in T.2.13) of the CVDD shall be smaller than or equal to one fifth of the magnitude of the MPE that would be applicable to the mean value of the measuring results.

6.4.3 Adjustment interval and drift

The drift at the end of the adjustment interval shall be smaller than or equal to half of the magnitude of the MPE. The adjustment interval and the adjustment procedure shall be specified by the manufacturer.

For CVDDs fitted with an automatic internal adjustment means, the means shall not be likely to drift and either the adjustment shall be performed automatically at the end of the adjustment interval or a warning calling for adjustment shall be generated automatically at the end of the adjustment interval.

6.4.4 Influence of the gas composition

The manufacturer has to specify the characteristics (limits of chemical composition) of the gas to be measured.

For gases of the same calorific value the influence of the composition shall be smaller than or equal to two-fifth (2/5) of the magnitude of the MPE.

Note: It is assumed that uncertainties on the CV of the calibration gases are consistent with the requirement.

6.4.5 Response time

The following provisions are applicable to the CVDD itself and not to the CVDD complemented with the sampling line.

Note: The delay due to the sampling line has to be considered included in the uncertainty component UT (shift in time).

For any instantaneous change in calorific value at least equal to 5 MJ within the measuring range, the change in indication after 1 h shall be at least 99 % of the effective variation. As a consequence, the measuring range shall be at least 5 MJ.

6.4.6 Influence of gas supply

The manufacturer shall provide reference conditions and rated operating conditions for:

- supply gas(es) pressure,
- supply gas(es) flowrates.

6.4.7 Specific provisions applicable to calorimeters

6.4.7.1 Influence of the atmospheric pressure

The CVDD shall be designed and manufactured so that it continues to operate as designed and so that its errors do not exceed the maximum permissible errors when it is subject to variations of the atmospheric pressure.

The corresponding rated operating conditions shall be specified by the manufacturer.

6.4.7.2 Installation effects

The manufacturer shall provide any necessary information on the capability of the calorimeter to be subject to ambient air movements (draughts). The type approval certificate states any appropriate information.

6.4.8 Specific provisions applicable to gas chromatographs

A gas chromatograph shall be capable to measure at least the following components:

Component

- Nitrogen
- Carbon dioxide
- Methane
- Ethane
- Propane
- Iso-butane
- n-butane
- n-pentane
- Iso-pentane
- neo-pentane
- Hexanes and superior

If the manufacturer claims for more components, calibration gases shall be chosen accordingly. The measuring range shall be specified by the manufacturer. It shall not start at zero and shall be not nil.

6.4.9 Other influences for all technologies

The manufacturer has to declare other influences he has identified. This declaration is checked at type approval taking into consideration the state of the art. To that purpose it is considered that an influence smaller than one fifth of the magnitude of the MPE is not significant.

Any significant influence (taking into consideration the state of the art) shall be specified in the type approval certificate, accompanied with relevant information.

In general the influence of the natural gas relative humidity is not relevant for technologies other than stoichiometric principle.

Taking here-above information into consideration, at type approval, initial verification or further verification, the Authority may:

- refuse the proposed CVDD if it does not suit the real situation of the measuring system,
- or impose to take significant influences into the uncertainty calculation,
- test other possible influences if it considers that the state of the art has not been respected (only at type approval).

6.5 MPEs for calculators

Maximum permissible errors, positive or negative, on calculation of quantities of gas, applicable to electronic calculators are equal to 0.05 % of true calculated value.

Note: This requirement is applicable to any calculation and not only to conversion calculation.

6.6 Repeatability error of a metering module

For any quantity greater than or equal to the volume or mass corresponding to five minutes at Q_{\max} , the repeatability error of the metering module shall be smaller than or equal to one fifth (1/5) of the value specified in first line of Table 2 (see test conditions in 10.2.7.3).

6.7 Endurance of a metering module

For a given gas, if applicable within their specified measuring ranges, metering modules shall present a magnitude of the variation of estimated systematic errors after the endurance test less than one fourth (1/4) of the MPE for the volume at metering conditions specified in first line of Table 2 (see test conditions in 10.2.6.2.4).

6.8 Maximum permissible errors for in service instruments or subsequent verifications

The MPEs for "in service" measuring systems and elements of measuring systems or at subsequent verifications should not exceed 1 time to 2 times (ratio to be set by the National Authority) the value permitted at initial verification.

7 Technical requirements for measuring systems

7.1 General

National regulations should state that taking advantage of MPEs or other tolerances in this Recommendation is prohibited and accordingly be prepared to take appropriate actions, in particular for what concerns:

- the policy concerning the choice and the use of calibration means,
- the adjustment of metering modules using adjustment or correction devices for adjusting respectively the WME or the errors to values other than as close as practical to zero, even when the errors are within the maximum permissible errors,
- the adjustment and use of CVDDs.

7.1.1 Ancillary devices

7.1.1.1 Where ancillary devices are made compulsory by this Recommendation or by a national or international regulation, they are considered as integral parts of the measuring system and are therefore subject to metrological control and shall conform to the provisions of this Recommendation.

7.1.1.2 When the ancillary devices are not subject to metrological control, the measuring system shall be examined to ensure that these ancillary devices do not affect the metrological performances of the measuring system. In particular, the system shall continue to operate correctly and its metrological functions shall not be affected when any kind of peripheral equipment, in particular an ancillary device, is connected (or disconnected).

In addition, these devices shall bear a legend which is clearly visible to the user to indicate that they are not controlled when they indicate a measurement result visible to the user.

7.1.2 Specified measuring ranges

7.1.2.1 The measuring ranges (flowrates, temperature, pressure...) of a measuring system shall be included within the measuring ranges of each of its components.

7.1.2.2 Where several meters are operated in parallel in a metering module, the limiting flowrates (Q_{\max} , Q_{\min}) of the different meters should be taken into account.

7.1.2.3 The measuring range shall satisfy the conditions of use of the metering module; the latter shall be designed so that the flowrate is between the minimum flowrate and the maximum flowrate, except during standstill.

The ratio Q_{\max}/Q_{\min} for the metering module shall be specified by the manufacturer.

7.1.3 Rated operating conditions

7.1.3.1 The conditions applied to measuring systems are divided into three groups:

- climatic conditions,
- mechanical conditions,
- electrical and electromagnetic conditions.

The classification is given in Annex A. The classes shall be in accordance with the conditions of use of measuring systems.

The environmental range of a measuring system shall be included within the environmental range of each of its components.

Notes: 1 Different environmental classes may apply to a measuring system. Not all components are installed in the same location for example: meters may be located in an open air facility while the

electronic calculators are located in a climate controlled room.

2 Applicable classes shall be determined at type approval and suitability for use shall be controlled at initial and subsequent verifications of the measuring system.

7.1.3.2 The rated operating conditions are specified in Annex A for each influence factor.

7.1.4 Indications

7.1.4.1 According to the type of measuring system, the final results are expressed in terms of:

- volume (at base conditions) or mass;
- energy that is the result of multiplying the gas quantity by the representative calorific value of the gas.

The symbol or the name of the unit shall appear in the immediate vicinity of the indication.

7.1.4.2 The measuring system shall be provided with devices capable of indicating measurement results (indicating, printing or memory devices) the total quantity (volume, mass or energy) and at least, for each meter line where appropriate, the following information:

- the volume at base conditions, the mass or the energy,
- the gas quantity at metering conditions,
- the corrected quantity if applicable,
- the correction values if applicable,
- the calorific value if applicable,
- the quantities measured by other associated measuring instruments (for example : pressure, temperature, and composition),
- the alarm indications,
- the conversion factor if applicable,
- the ratio of the compressibility factors Z/Z_b ,
- any input data affecting the metrological results.

7.1.4.3 The use of the same display for the indications of volume at metering conditions of volume at base conditions, of mass or energy is authorised provided that the nature of the displayed quantity is clear and that these indications are available on request.

The energy or when not available the volume at base conditions or the mass shall be preferably displayed. This relevant quantity shall be displayed permanently or shall be capable of being displayed by special command.

7.1.4.4 A measuring system may have several devices indicating the same quantity. Each shall meet the requirements of this Recommendation if they are mandatory or necessary. The scale intervals of the various indications may be different.

7.1.4.5 For any measured quantity relating to the same measurement and measurand, the indications provided by various devices shall not deviate one from another by more than one scale interval or the greater of the two scale intervals if they differ.

7.1.4.6 Primary indications on volumes, mass and energy (when applicable) shall be available up to the settlement of the transaction. National Authorities may prescribe duration for the availability of these indications.

Moreover when a printing or memory device is required or used to ensure this availability, there shall have provisions to allow for automatic printing or memorising at predetermined time intervals. The printing and/or memory device(s) shall be capable of printing and/or memorising thermodynamic parameters, totals, starting and ending time of the various alarms as well as all relevant information to establish the chronology of the metering events for example printed sheet numbering, date, hour, etc.

7.2 Metering module

7.2.1 General

7.2.1.1 The meter(s) of a metering module shall comply with applicable International Recommendations when they exist, unless otherwise indicated in this Recommendation. The maximum permissible errors laid down in this Recommendation are applicable to the metering module and not to the meter alone.

7.2.1.2 The construction of the metering module shall allow installation of individual meters that conform to the assembling requirements.

Gas meters shall be mounted in the pipeline, according to:

- the provisions laid down in the type approval certificate of the metering module if the latter has been provided,
- the provisions of applicable ISO standards,
- the manufacturer's instructions and in general,
- the requirements of this Recommendation.

7.2.1.3 If the gas is likely to flow in both directions the metering module shall be designed and controlled in order to perform accurate measurements in both directions and shall record corresponding quantities separately. If the metering module is not designed and controlled in order to perform accurate measurements in both directions, the flow direction shall be clearly marked and the metering module shall be fitted with a non-return device if necessary.

7.2.1.4 If a meter is likely to be overloaded given the supply conditions, a flow limiting device shall be provided. This device shall be installed downstream of the meter. It shall be possible to seal it (see 7.6). The flow limiting device may be mechanical or electronic.

7.2.1.5 Valves that may influence the accuracy of measurements shall be fitted with provisions for sealing.

7.2.1.6 Any additional device connected to the metering module shall be designed so that it does not interfere with the accuracy of the metering process. The meter has to be isolated from the gas pulsations generated, for instance, by a flow regulator or a gas compressor (see B.2 in particular).

7.2.1.7 If the system is fitted with heating devices upstream of the metering lines, a device shall keep the temperature within an acceptable operating temperature range, according to the conversion device used.

7.2.2 Parallel branches

7.2.2.1 Given the specified measuring range of the flowrate it may be necessary to consider several branches in parallel. Meters placed in parallel measuring branches shall not be able to influence the metrological characteristics of each other.

7.2.2.2 National Authorities may decide that the metrological control requires a number of parallel lines so that the maximum flow can be measured when any one line is at standstill while the other lines are working within their specified limits.

7.2.2.3 If there is a possibility to put parallel lines in series, the connections shall be arranged on the main pipes upstream and downstream of the straight lines required upstream and downstream of the meter.

Generally, an isolation valve has to be placed upstream and another one downstream (for instance, a stop valve with venting to the air) for each line.

7.2.2.4 Metering modules shall have provisions to select parallel branches so that the flowrate in each branch lies between Q_{\max} and Q_{\min} of the meter. The connection or disconnection of the parallel branches may be manual or automatic.

7.2.2.5 The design shall have provisions to avoid any gas flow, actual or fictive, through closed branches. This may involve mechanical and/or checking facilities.

7.2.3 By-passing

7.2.3.1 The contractual availability of the gas flow could require to by-pass the station.

When the metering module is by-passed, the beginning and ending time of this operation shall be recorded.

7.2.3.2 When rapid action valves are integrated into the installation, an equilibrium by-pass with a small diameter shall be provided. The by-pass should be controlled by a throttle valve facilitating the process of putting the meter and the associated piping under pressure and preventing the gas meter from being damaged.

7.2.4 Test possibility on site

The National Authority may require provisions to be made for using any recognised method for checking and/or verifying the metering module on site in particular metering modules with Q_{\max} equal to or greater than 10 000 m³/h at base conditions (or equivalent for mass).

7.3 Converting into volume at base conditions or mass

The text of this subclause is mainly applicable to the conversion devices for which the conversion calculations are made numerically by means of an electronic calculator. Similar concepts may be applied by analogy to other types of conversion devices.

7.3.1 Base conditions

The following base conditions are preferred by some ISO standards: 101.325 kPa and 288.15 K to determine the volume, and 288.15 K to determine the calorific value. Conversion to other conditions may be conducted in accordance with the relevant ISO or national standards.

7.3.2 Types of conversions

Six types of conversion are treated in this Recommendation:

- volume conversion as a function of temperature only (called T conversion);
- volume conversion as a function of the pressure and of the temperature with constant compressibility factor (called P T conversion);
- volume conversion as a function of the pressure, the temperature and taking into account the compressibility factor (called P T Z conversion); and,
- volume conversion as a function of the density (density conversion),
- mass conversion as a function of volume and density at metering conditions,
- mass conversion as a function of volume and density at base conditions.

The connection between the calculator and the measuring transducers, if they exist, are elements of the conversion device.

This Recommendation deals with tested conversion devices as one instrument, or as a calculator and its associated measuring instruments.

7.3.2.1 Volume conversion as a function only of temperature (T conversion)

In this case the conversion device consists in a calculator and a temperature transducer and it converts the volume V at metering conditions and temperature T to the base conditions (pressure P_b , temperature T_b , Z_b).

The volume at base conditions V_b is obtained by the relationship:

$$V_b = K \times \frac{1}{T} \times V$$

K is a fixed value obtained by the relationship:

$$K = \frac{P}{P_b} \times T_b \times \frac{Z_b}{Z}$$

The pressure and Z are not measured, but shall be included as fixed values in the processing of the conversion factor.

7.3.2.2 Volume conversion as a function of pressure and temperature (PT conversion)

In this case the conversion device consists in a calculator, a pressure transducer and a temperature transducer. The compressibility factor may be considered as a fixed value calculated from mean metering conditions and a mean gas composition.

The volume at base conditions is obtained by the relationship:

$$V_b = K' \times \frac{P}{T} \times V$$

K' is a fixed value obtained by the relationship :

$$K' = \frac{1}{P_b} \times T_b \times \frac{Z_b}{Z}$$

Z is not measured, but shall be included as a fixed value in the processing of the conversion factor.

7.3.2.3 Volume conversion as a function of pressure, temperature and deviation from the perfect gas law (PTZ conversion)

In this case, the conversion device consists in a calculator, a pressure transducer, a temperature transducer and optional associated measuring instruments measuring gas compressibility.

The deviation from the ideal gas law is compensated by the measurement or calculation of the compressibility factor using an appropriate equation as a function of pressure, temperature and gas properties.

Non measured gas parameters used for the compressibility calculation can be preset at installation time.

The volume at base conditions is obtained by the relationship:

$$V_b = \frac{P}{P_b} \times \frac{T_b}{T} \times \frac{Z_b}{Z} \times V$$

7.3.2.4 Volume conversion as a function of density (density conversion)

In this case, the conversion device consists in a calculator and a density transducer.

The volume at base conditions V_b is obtained by the relationship:

$$V_b = \frac{V \times \rho}{\rho_b}$$

Where:

V: volume at metering conditions

ρ : density at metering conditions

ρ_b : density at base conditions

ρ_b is provided in ISO 6976.

7.3.2.5 Mass conversion as a function of volume and density at metering conditions

In this case, the conversion device consists in a calculator and a density transducer.

The mass M is obtained by the relationship:

$$M = V \times \rho$$

Where:

V: volume at metering conditions

ρ : density at metering conditions

7.3.2.6 Mass conversion as a function of volume and density at base conditions

In this case, first the volume at metering conditions is converted into a volume at base conditions using one of the appropriate here above types of conversion.

Then the mass M is obtained by the relationship:

$$M = V_b \times \rho_b$$

Where:

V_b : volume at base conditions

ρ_b : density at base conditions

ρ_b is provided in ISO 6976.

7.3.3 Associated measuring instruments

In principle, the characteristic quantities of the measured gas used for the conversion shall be measured by means of associated measuring instruments.

However, depending on national regulations, it is permitted that some of those quantities are not measured at the measuring system location or that the associated measuring instruments are not subjected to a control when it can be demonstrated that MPE requirements on converted value are fulfilled. This demonstration is part of documented provisions.

7.3.3.1 Temperature sensor

The temperature sensor shall be installed in order to ensure that the measured temperature is the temperature at metering conditions. It shall be possible to verify on site the measured temperature. For this purpose, an additional independent temperature tapping shall be located at a short distance from the verified temperature sensor.

7.3.3.2 Pressure transducer

The pressure transducer shall be connected to the metering pressure tap of the meter

To avoid the errors due to atmospheric pressure variation, the absolute pressure shall be determined.

When a gauge pressure transducer is used, it shall be possible to preset the value of the average atmospheric pressure. The value of the atmospheric pressure shall be calculated taking into account the altitude of the installation site.

It shall be designed so that the pressure measurement can be verified using an additional appropriate pressure measurement means (tap or T connection) at the pressure measurement point.

7.3.3.3 Non standard measuring points

The associated measuring instruments for which there are no standard tapping point shall be installed close to the meter in order to determine with sufficient accuracy the quantities concerned.

Provided that this is accomplished satisfactorily, measuring instruments may be used to produce conversions and corrections for meters.

These instruments shall not affect the correct functioning of the meter(s).

The deviation in indication due to the locations of the measuring points shall not exceed 20% of the maximum permissible error for the conversion. Subject to fulfilment of this requirement, the same associated measuring instruments may be used for making conversions and corrections for two or more meters.

Note: This requirement is checked by calculation.

7.3.4 Installation

The conversion device shall be installed in a manner suitable for its application. The presence of the conversion device shall not affect the metrological integrity of the meter(s) and device(s) to which it is associated.

The conversion device and the associated measuring instruments shall operate within their rated operating conditions.

The connections of the associated measuring instruments shall be in accordance with manufacturer requirements and type approval certificates.

7.4 Determination of energy

7.4.1 Time interval for determination of CV

7.4.1.1 In principal the energy to be determined should be the sum of instantaneous energies delivered. However in practice this is not possible and it is acceptable not to associate the instantaneous calorific value to the instantaneous corresponding volume at base conditions or mass if :

- a representative CV is determined at time intervals greater than or equal to the minimum time interval laid down in table 4,
- this representative CV is based on individual CV measurements at time intervals smaller than or equal to the maximum acceptable value laid down in table 4,
- the representative CV is associated to the quantity measured during the time interval the representative CV is determined,
- the stability of CV during the time interval of determination of the representative CV is considered as component of uncertainty.

In other words this leads to a conventional true value resulting from the multiplication of the measured quantity during a period of time at least equal to the minimum time interval by the representative CV corresponding to this duration. Moreover excepted particular identified cases or national practice, it is not necessary to take into consideration the variation of consumption during this period.

The National authority may impose a maximum time interval for the determination of the representative CV.

TABLE 4
Time interval for measuring CV and determining the representative calorific value

ACCURACY CLASS	A	B	C
Maximum acceptable time interval for individual CV measurements	15 min and depending on CV stability	1 h	1 h
Minimum time interval for Representative CV determinations	Suitable for the application	1 d	1 d

Note: these values apply whatever is the way of sampling or of measuring.

7.4.1.2 In general, the accuracy on energy is verified on a modular approach and the notion of minimum specified energy deviation is meaningless in this case. In the case of the direct verification of energy, as laid down in 6.2, the magnitude of the maximum permissible error is never smaller than the minimum specified energy deviation. For this purpose the minimum measured quantity for energy MMQ_e is :

$$MMQ_e = Q_{\min} \times t \times H_s$$

Where:

Q_{\min} : minimum flowrate of the measuring system for the volume at base conditions or mass

t: the greater of the two following values :

- effective time interval between determining representative calorific values for the transaction,
- 1 h.

H_s : nominal (mean) measurable calorific value specified by the gas supplier.

7.4.2 Determination of the error on energy

7.4.2.1 Error of the CVDD

For calculating the error on CV it is possible to use the actual measurement errors of the CVDD but in general the errors of the CVDD can not be known for each condition of use. Instead of this it is easier to consider the MPEs applicable to the CVDD. It is considered that a CVDD fulfilling all the requirements provided in 6.4 has measurement errors smaller than or equal to MPEs which are applicable to it.

These MPEs, noted MPECVDD latter, are used as the relevant component to calculate the error on CV.

For the combination of components and as far as necessary, these MPEs may be reduced to a resulting “standard uncertainty”, u_{CVDD} , dividing by the appropriate coverage factor (see 7.4.2.6).

7.4.2.2 Uncertainty on time determination

The provision in 7.4.1 has to be fulfilled and by convention the expanded uncertainty on time determination is assumed to be nil provided the sampling transit and the delay for gas analysis are negligible or can be corrected for without significant uncertainty.

When it is not the case this component is evaluated according to the relevant documented provisions. At the level of this IR it is not possible to state more provisions on this and the validation of the evaluation of this component is of the responsibility of the Authority.

For the combination of components and as far as necessary, this expanded uncertainty may be reduced to a resulting standard uncertainty, u_T , dividing by the appropriate coverage factor (see 7.4.2.6).

7.4.2.3 Uncertainty on CV stability

During the time interval the representative CV is determined, the stability of the instantaneous CV leads to an uncertainty component, UC.

This component is evaluated according to the relevant documented provisions. At the level of this IR it is not possible to state more provisions on this and the validation of the evaluation of this component is of the responsibility of the authority. Annex C provides examples.

For the combination of components and as far as necessary, this expanded uncertainty may be reduced to a resulting standard uncertainty, u_C , dividing by the appropriate coverage factor (see 7.4.2.6).

7.4.2.4 Uncertainty on location

When the CV is not locally determined, the corresponding expanded uncertainty, UL, is evaluated according to the relevant documented provisions. This component may be due to two main causes: different origins of gases and the transit delay of the gas between the measuring points for the metered quantity and for CV. At the level of this IR it is not possible to state more provisions on this and the validation of the evaluation of this component is of the responsibility of the authority. Annex C provides examples.

For the combination of components and as far as necessary, this expanded uncertainty may be reduced to a resulting standard uncertainty, u_L , dividing by the appropriate coverage factor (see 7.4.2.6).

7.4.2.5 Other uncertainties

Without any particular reason, the value of this component is nil. However the Authority may decide it is not the case for instance when:

- the configuration of the MS is complex and it is necessary to determine standard uncertainties according to type A as laid down into the GUM,
- the gas consumption has been identified as non constant (in a specific contract for instance) and likely to have a significant effect on the final result,
- the level of confidence on the traceability of the CV is not sufficient in case of non secured communications,
- there are possible effects of interference components on CV measurements as indicated in 6.4.9.

In this case, the corresponding expanded uncertainty, UO , is evaluated according to the relevant documented provisions and if relevant the type approval certificate of the CVDD. At the level of this IR it is not possible to state more provisions on this and the validation of the evaluation of this component is of the responsibility of the Authority.

For the combination of components and as far as necessary, this expanded uncertainty may be reduced to a resulting standard uncertainty, uO , dividing by the appropriate coverage factor (see 7.4.2.6).

7.4.2.6 Combination of components

Without any particular reason the conventional coverage factor for determining any of the here above corresponding standard uncertainties (from the expanded uncertainty) is 2. This figure is also used when determining the combined error on CV, E_{CV} , after the corresponding standard uncertainty has been calculated.

7.4.2.6.1 Simple case

The following is applicable to simple cases such as only one local CVDD, but also to complex situations provided some assumption may be done. The examples provided in Annex C should cover a lot of situations.

When all coverage factors are equal to 2 this combined error is provided by one of the two following formulas:

$$E_{CV} = \sqrt{MPE_{CVDD}^2 + U^2_T + U^2_C + U^2_L + U^2_O}$$
$$E_{CV} = 2\sqrt{u^2_{CVDD} + u^2_T + u^2_C + u^2_L + u^2_O}$$

Where:

$$u_{CVDD} = MPE_{CVDD}/2 \quad \text{and} \quad u_i = U_i/2 \quad (i = T, C, L, O)$$

When all coverage factors may not be considered equal to 2 or when an uncertainty component is directly calculated as an experimental standard deviation, it is appropriate to use the second formula.

E_{CV} is the error on determination on CV and, as already mentioned and because calculation errors are very small, is also the error on converting in energy.

7.4.2.6.2 Complex case

In a real complex case, it would be necessary to calculate the combined uncertainty according to the GUM, taking into consideration either elementary standard uncertainties as laid down here above and/or any appropriate standard uncertainty components evaluated according documented provisions.

The error on CV determination is twice this combined uncertainty.

7.4.2.7 Error of the energy measuring system

When the performances are evaluated according to a modular approach (general case), the error of the measuring system is meaningless as each module fulfils the requirements applicable to it, and taking into account that the global MPEs are calculated on the basis of MPEs applicable to the modules.

7.5 Marking

7.5.1 Each measuring system, metering module, device or associated measuring instrument, which has been the subject of a type approval, shall bear, legibly and indelibly, either on the indicating device or on a special identification plate, the following indications, as far as relevant:

- a) type approval mark;
- b) manufacturer's identification mark or trademark;
- c) name chosen by the manufacturer (not compulsory);
- d) serial number and manufacturing year; and, if applicable,
- e) minimum flowrate, Q_{\min} ;
- f) maximum flowrate, Q_{\max} ;
- g) maximum gas pressure, P_{\max} ;
- h) minimum gas pressure, P_{\min} ;
- i) maximum gas temperature, T_{\max} ;
- j) minimum gas temperature, T_{\min} ;
- k) accuracy class;
- l) nature of the measured gas(es);
- m) minimum calorific value ;
- n) maximum calorific value ;
- o) climatic and mechanical class, I or O as defined in Annex A;
- p) appropriate information related to the determination of the compressibility factor.

If several meters are operating in one single system, using common elements, the indications prescribed for each part (element) of the system may be gathered on one single plate.

The indications, inscriptions or diagrams required by this Recommendation or by the type approval certificate, shall be written legibly either on the indicating device or close to it.

7.5.2 The measuring system designer shall ensure that markings identified on the indicating device of any meter which is part of the measuring system shall not contravene those on the identification plate of the measuring system (for example the range Q_{\min} - Q_{\max} indicated for the meter may not be greater than the corresponding range for the metering module).

7.6 Sealing

7.6.1 General

Sealing is preferably carried out by means of lead seals. However, other types of sealing are permitted on fragile instruments or when these seals provide sufficient integrity, electronic seals for instance.

Seals shall, in all cases, be easily accessible.

Sealing devices shall be provided on all parts of the measuring systems that cannot materially be protected otherwise against action likely to influence the measuring accuracy.

Sealing devices should prevent the parameters (among others correction and conversion parameters) used for determining the measuring results from being altered when these parameters are not managed according to documented provisions or quality assurance system providing traceability of modifications.

A stamping plate, aimed at receiving the control marks shall be sealed or shall be permanently fixed on the measuring system. This stamping plate may be combined with the identification plate of the measuring system.

7.6.2 Electronic sealing devices

7.6.2.1 When access to parameters that participate in the determination of results of measurement needs to be protected but is not protected by mechanical seals, the protection shall fulfil the following provisions:

- a) Access shall only be allowed to authorised people, for example by means of a code (key-word) or of a special device (hard key, etc.); the code shall be changeable. However the National Authority may consider that a code is not sufficient;
- b) It shall be possible to memorise all interventions between two verifications. The record shall include the date and a characteristic element identifying the authorised person making the intervention (see a) above) ; the traceability of interventions shall be assured for at least two years; if deletion of a previous intervention must occur to permit a new record, the oldest record shall be deleted.

7.6.2.2 For measuring systems with parts which may be disconnected one from another by the user and which are interchangeable, the following provisions shall be fulfilled:

- a) It shall not be possible to access parameters that participate in the determination of results of measurements through disconnected points unless the provisions in subclause 7.6.2.1 are fulfilled;
- b) Interposing any device which may influence the accuracy shall be prevented by means of electronic and data processing securities or, if not possible, by mechanical means.

7.6.2.3 For measuring systems with parts which may be disconnected one from another by the user and which are not interchangeable, the provisions in subclause 7.6.2.2 apply. Moreover, these measuring systems shall be provided with devices which do not allow them to operate if the various parts are not connected according to the manufacturer's configuration.

Note: Disconnections which are not allowed to the user may be prevented, for example by means of a device that prevents any measurement after disconnecting and reconnecting.

8 Technical requirements for meters, metering modules and ancillary devices

8.1 Meters and metering modules

8.1.1 Adjustment device

Meters and metering modules may be provided with an adjustment device which permits modification of the ratio between the indicated volume and the actual quantity passing through the system, by a simple operation.

When this adjustment device modifies this ratio in a discontinuous manner, the consecutive values of the ratio shall not differ by more than 0.001 for classes A and B or 0.002 for class C.

After the determination of the errors of indication, the adjustment shall be made so that the weighted mean error (WME) is as close to zero as the adjustment device permits. The WME has to be calculated at nominal operating conditions.

Adjustment by means of a by-pass of the meter (s) is prohibited.

8.1.2 Correction device

Metering modules may be fitted with correction devices; such devices are always considered as an integral part of the metering module.

The maximum permissible errors defined in Table 2 are applicable to the corrected quantity (at metering conditions).

The purpose of a correction device is to reduce the errors as close to zero as possible.

All the parameters which are not measured but are necessary for correcting shall be contained in the calculator before any measurement operation. The type approval certificate shall prescribe the conditions of checking parameters that are necessary for correctness at the time of verification of the correction device.

The correction device shall not allow the correction of a pre-estimated drift in relation to time or volume, for example.

When using a correction device one shall ensure that the error curve to be used is relevant to the actual operational conditions and that the correction device is able to correct all deviations recorded when calibrating the metering module to which it is connected.

The error curve shall be corrected by a correction function $f(q)$ such that for each operating point the corrected quantity shall equal the indicated quantity of the meters times the correction function $f(q)$.

The parameters that determine the correction function $f(q)$ can be derived of the following:

- from a table of deviations for all the different flowrates noted via the calibration. (for example correction by linear interpolation between all the calibration points); or
- from the coefficients of a polynomial having an appropriate degree, and obtained by smoothing of all points noted on calibration (smoothing through the method of least squares, cf. ISO 7066); or
- by any other method to be specified by the manufacturer.

In any case, the choice of the parameters of the correction function $f(q)$ shall ensure that at all points, the error curve is definite, continuous and derivable for flowrates between Q_{\min} and Q_{\max} .

The correction shall be only authorised between the different calibration points (no extrapolation is allowed). As a consequence, there never can be a correction below Q_{\min} and above Q_{\max} .

The manufacturer has to demonstrate the time reaction of a correction device is consistent with the expected accuracy in case of quick variations of flowrates.

8.2 Indicating device

8.2.1 General provisions

8.2.1.1 Reading of the indications shall be precise, easy and unambiguous. If the device comprises several elements, it shall be arranged such that the reading of the measured quantity can be made by simple juxtaposition of the indications of the different elements.

The decimal sign shall appear distinctly.

Indications of principal measurands shall be expressed with eight significant digits.

8.2.1.2 The scale interval of indication shall be in the form 1×10^n , 2×10^n or 5×10^n in authorised units of the measured quantity, where n is a positive or negative whole number, or zero.

8.2.1.3 For metered quantities the minimum specified quantity deviation as defined in T.2.12 shall be equal to or greater than the following value:

- for continuous indicating devices, the measured quantity corresponding to 2 mm on the scale or to one-fifth of the scale interval (of the first element for mechanical indicating devices), whichever is greater, and;
- for discontinuous indicating device, the measured quantity corresponding to two scale intervals.

8.2.2 Mechanical indicating device of meters

When the graduation of an element is entirely visible, the value of one revolution of that element shall be in the form 10^n authorised units of volume, mass or energy; this rule however, does not apply to the element corresponding to the maximum range of the indicating device.

On an indicating device having several elements, the value of each revolution of an element whose graduation is entirely visible must correspond to the scale interval of the following element.

An element of the indicating device may have continuous or discontinuous movement, but when elements other than the first have only part of their scales visible through the windows, these elements shall have discontinuous movement.

The advance by one figure of any element having discontinuous movement shall occur and be completed when the preceding element passes from 9 to 0.

When the first element has only a part of its scale visible through a window and has a continuous movement, the dimension of that window shall be at least equal to 1.5 times the distance between two consecutive graduated scale marks.

All scale marks shall have the same width, constant along the line and not exceeding one quarter of the scale spacing. The apparent scale spacing shall be equal to or greater than 2 mm. The apparent height of the figures shall be equal to or greater than 4 mm, unless otherwise specified in the requirements for particular measuring systems.

8.2.3 Electronic indicating device

The minimum height of the figures shall be 4 mm. and the minimum width shall be 2.4 mm.

It shall be possible to read the displayed values clearly and correctly, within an angle of 55° from normal to the window, within the ambient specified temperature range.

When all the digits of the indicating device are not used, every digit at the left of the indicating device that is not used shall indicate zero.

If the display is non-permanent, the indication time shall be at least 10 s.

Moreover where the display is sequential and automatic, the energy or when not available the volume at base conditions or the mass shall be displayed at intervals no longer than 15 s. Each quantity shall be displayed for at least 5 s.

8.3 Printing device

8.3.1 Printing scale

The printed scale interval shall be in the form of 1×10^n , 2×10^n or 5×10^n authorised units of quantity, n being a positive or negative whole number, or zero.

The printing scale shall not be smaller than the smallest scale interval of the indicating devices

8.3.2 Printed quantity

When a printing device is provided the measuring result, the measurement unit used or its symbol and the decimal sign if any, shall be printed.

8.3.3 Identification parameters

The printing device may also print information identifying the measurement sequence such as: sequence, number, date, identification of the meter, etc.

If the printing device is connected to more than one measuring system, it shall print the identification of the relevant system.

8.4 Memory device

8.4.1 Storage unit

Measuring systems may be fitted with a memory device to store measurement results until their use or to keep a trace of commercial transactions, providing proof in case of a dispute. Devices used to read stored information are considered as included in the memory devices.

8.4.2 Media reliability and capacity

The medium on which data are stored must have sufficient permanency to ensure that the data are not corrupted under normal storage conditions. There shall be sufficient memory storage for any particular application.

8.4.3 Exhausted storage capacity

When the storage is full, it is permitted to delete stored data when both the following conditions are met:

- data are deleted in the same order as the recording order and the rules established for the particular application are respected,
- deletion is carried out after a special manual operation.

8.4.4 Data storage protection

Memorisation shall be such that it is impossible to modify stored values without breaking the seals or similar actions.

8.5 Associated measuring instruments

8.5.1 General

The associated measuring instruments shall conform to pertinent International Standards and Recommendations. Additionally, those instruments shall exhibit accuracy such that the requirements on accuracy of measuring systems and components in subclause 6.3 are fulfilled.

The instruments used for measuring the temperature, pressure, differential pressure, density and used to determine the calorific value shall display directly and/or record the measured values, or shall be fitted with a transmitter to send signals to separate equipment used to display, record or store the measured quantities. In any case the measuring result shall be accessible.

8.5.2 Scale intervals for associated measuring instruments other than CVDD

The indication scale intervals of the density, pressure and temperature shall not exceed 25 % of the maximum permissible errors for the associated measuring instruments.

8.5.3 Scale interval for CVDD

According to the case the scale interval shall be either 5 kJ/m^3 or 1 Wh/m^3 , or 5 kJ/kg or 1 Wh/kg .

8.6 Volume conversion device

8.6.1 General

8.6.1.1 All the constituent elements of conversion devices shall be constructed of materials having appropriate qualities to resist the various forms of degradation which may occur under normal operating conditions as specified by the manufacturer. Properly installed conversion devices shall also be able to withstand normal external influences. Conversion devices shall, in all circumstances, withstand the overload of pressure and the temperatures for which they are designed, without malfunction.

8.6.1.2 A conversion device shall be designed in such a way that it does not degrade the accuracy of the measurement of the meter with which it is associated.

8.6.1.3 The conversion factor shall be recalculated at intervals not exceeding thirty seconds.

However, when no signal has been received from the gas meter for over thirty seconds, the recalculation is not required until a next signal is received.

8.6.1.4 Conversion devices may be fitted with interfaces allowing the connection of supplementary devices. Such connections shall not corrupt the metrological operation of the conversion device.

8.6.1.5 The interconnection cables between the calculator and the transducers are integral parts of the conversion device. The manufacturer shall specify the length and characteristics of the interconnection links where these may affect the safety or accuracy of measurement or the conversion device.

8.7 Calculator

8.7.1 The non measured data necessary to conversions and correction shall be present in the calculator before a measurement. It shall be possible to print or display them from the calculator memory. Any modification to the non measured data shall require breaking of security seals or updating an audit trail.

8.7.2 In case of any calculator halt, it shall maintain in memory the principal measurands, input parameters for example pressure, temperature and alarm indications. The calculator shall maintain the values prevailing at the moment it was halted.

The data will remain accessible for a minimum of six months. The calculator shall be capable of resuming normal operation as soon as the reason for the halt is removed.

8.8 Calorific value determining device

8.8.1 Types of calorific value determining devices

The calorific value of natural gas can be determined using different techniques which fall into the following categories:

- direct measurement, i.e.
 - direct combustion,
 - catalytic combustion,
- indirect measurement, i.e.
 - stoichiometric combustion,
- inferential determination, i.e.
 - correlation with other measured properties,
 - composition based calculation.

Depending on some conditions, on-line or off-line measuring devices may be used.

One-line calorific value determining devices have their sampling system directly connected to the gas network.

For off-line calorific value determining devices sampling is performed indirectly using for instance gas vessels.

When provided, the sampling system shall not influence other parts of the measuring system and shall also allow taking representative samples of the gas having passed the meter.

Guide-lines for the design and operation of sampling systems are described in ISO 10715 (Natural gas-Sampling guide-lines).

8.8.2 Adjustment procedures

The aim of an adjustment procedure is to bring the calorific value determining device in situation of operating according to its intended use and accuracy.

If applicable (see 6.4.3 and 8.8.3), the manufacturer shall provide the appropriate adjustment procedure.

In particular adjustment procedures shall be established taking into account the following factors:

- the number of calibration gases to cover the operational range;
- the adjustment interval (i.e. the interval between adjustments will be a function of the stability and the repeatability of the measuring instrument);
- the duration of the adjustment test and the number of adjustments.

These calibration gases shall be prepared and certified according to Annex E.

The measurement uncertainty of calibration gases shall fulfil the requirement in 10.

For chromatographic devices, the gas shall contain the essential components.

8.8.3 Adjustment range

The adjustment range shall be limited in order to prevent excessive corrections. The corresponding limits shall be suitable for the intended use. Outside the range the CVDD shall no longer operate and generate a warning message.

8.8.4 Metrological policy concerning calorific value measurements

According to their policy, metrological Authorities may impose, in particular, one or more provisions of the following:

- periodicity of routine verifications of CVDD by the user,
- periodicity of routine adjustments of CVDD by the user,
- prohibiting the access to adjustment devices of CVDD to the user,
- the presence of automatic internal adjustments means for CVDD,
- the type(s) of CVDDs to be used.

8.8.5 Storage of data

The CVDD shall be accompanied with an ancillary device allowing the storage of appropriate data in order to determine representative calorific values.

8.9 Energy conversion device

Any relevant provision in 8.6 applies by analogy to energy conversion devices.

9 Technical requirements for electronic devices

9.1 General requirements

9.1.1 Electronic measuring systems and devices shall be designed and manufactured so that they continue to operate as designed and so that their errors do not exceed the relevant maximum permissible errors under rated operating conditions and which are defined in 6.2 and 6.3.

Note: For manufactured measuring instruments national or regional regulations may foresee that continuing to operate under rated operating conditions is the responsibility of the manufacturer. This may allow the manufacturer to replace purely digital elements which can not influence the characteristics and/or the performance of the measuring instruments by other equivalent elements without having to demonstrate that the MI continues operating as designed.

9.1.2 Electronic measuring systems and devices shall be designed and manufactured in such a way that no significant faults occur when they are exposed to the disturbances specified in Annex A.

9.1.3 The requirements in 9.1.1 and 9.1.2 shall be met durably. For this purpose electronic measuring systems shall be provided with the checking facilities specified in 9.3. However this requirement is not applicable to the internal securing (internal checking facilities...) of gas meters designed in conformity with an OIML International Recommendation.

9.1.4 A pattern of a measuring system or device is presumed to comply with the requirements in 9.1.1 to 9.1.3 if it passes the examination and tests specified in (10.2.11.1 and 10.2.11.2).

9.1.5 Measuring systems shall permit the retrieval of the information relating to the measured quantity contained within the instrument before a significant fault occurred and was detected by checking facilities.

9.1.6 Electrical connections should clearly be identified. If they are intended for use with separately approved peripheral equipment, they shall conform to the electrical interfacing standard used by the peripheral equipment to transmit their information. Compatibility will not only include the electrical levels and signal shape but also the communication protocol in use.

Note: This paragraph is only applicable to the metrological aspects of the liaison.

9.2 Power supply device

9.2.1 External power supply (AC or DC)

In case of failure of the external power supply and, if provided, before failure of the emergency power supply, the latest measured parameters and alarms shall be recorded.

9.2.2 Battery powered device

The manufacturer shall specify the minimal duration of functioning without replacing the battery under the following conditions:

- maximum allowable frequency input from the meter;
- minimum ambient temperature;
- P_{\max} and T_{\min} .

The instrument shall indicate that the battery or any form of electrical supply has to be recharged or replaced before 90 % of the life or of the estimated life of the battery has been exceeded.

The replacement of the battery shall be possible without breaking any metrological seals of the device. Separate seals may be provided for the battery enclosure.

During the battery exchange the following information has to be retained (when applicable):

- the energy,
- the volume at base conditions,
- the mass,
- the volume at metering conditions,
- the corrected volume,
- the calorific value,
- the alarms indications,
- the event logs,
- the entered data specified in 8.7.1.

The type of battery(ies) specified by the manufacturer shall be used.

9.3 Checking facilities

9.3.1 Action of checking facilities

The detection by the checking facilities of significant faults shall result in the following actions, according to type:

9.3.1.1 Checking facilities of type N

A visible or audible alarm for the attention of the operator.

9.3.1.2 Checking facilities of types I or P

- automatic correction of the fault, or,
- stopping only the faulty device when the measuring system without that device continues to comply with the regulations, or,
- a visible or audible alarm for the operator. This alarm shall operate until the cause of the alarm is suppressed. In addition, when the measuring system transmits data to ancillary devices, the transmission shall be accompanied by a message indicating the presence of a fault.

Notes: 1 The third action is not applicable for the disturbances specified in Annex A, as no significant fault is allowed during the tests.

2 In addition, the metering system may be provided with devices to estimate the amount of gas having passed through the installation during the occurrence of the fault. The result of this estimate shall not be capable of being misinterpreted for a valid indication.

However a visible alarm or audible alarm is not sufficient unless the alarm is transferred to a remote station. The transmission of the alarm need not to be secured provided its occurrence, if any, remains accessible until the settlement of the transaction.

9.3.2 Checking facilities for the flow measuring device

The objective of these checking facilities is to verify the presence of the flow measuring device, its correct operation and correctness of data transmission.

9.3.2.1 When the signals produced by the flow measuring devices are made up of pulses, each being representative of an elementary volume, the checking facility shall operate at least every two pulses. However if the period between two consecutive pulses is smaller than 30 seconds, it is not required for the checking facility to operate more than once a minute.

The flow measuring devices may generate more than one primary signal from different origins (different phases and/or frequencies). In this case, a checking facility of type I may also be used to compare the different signals.

When the signals produced by the flow measuring devices are made up of pulses, each being representative of an elementary volume, the security Level B specified in the "ISO 6551 Standard" shall at least be respected, except for equipment with a cable length at most 3 meters, for which Level C may be applied.

It shall be possible to demonstrate the operation of this checking facility during type approval:

- either by disconnecting the measuring transducer,
- either by removing one of the impulse sources of the sensor,
- either by removing the power supply of the measuring transducer.

This checking shall be also possible at initial verification unless the presence and the efficiency of the checking facility are ensured by the conformity to type.

9.3.2.2 In case of any other technological choice, the checking facility shall assure equivalent levels of security.

9.3.3 Checking facilities for the calculator

The following requirements apply to any part of the system that performs calculations, the calculator of course but also particular, to calorific value determining devices or if applicable to other associated measuring instruments.

The object of these checking facilities is to check that the calculator system functions correctly and ensure the validity of the calculations made.

There are no special means required for indicating that these checking facilities function correctly.

9.3.3.1 The checking of the functioning of the calculation system shall be of types P or I. In the latter case, the checking shall occur, at least, every five minutes.

The objective of the checking is to verify that:

a) the values of all permanently stored instructions and data are correct, by such means as:

- summing up all instructions and data codes and comparing the sum with a fixed value,
- line and column parity bits (LRC and VRC),
- cyclic redundancy check (CRC 16),
- double independent storage of data,
- storage of data in "safe coding", for example protected by checksum, line and column parity bits,

b) all procedures of internal transfer and storage of data relevant to the measurement result are performed correctly, by such means as:

- write read routine,
- conversion and reversion of codes,
- use of "safe coding" (check sum, parity bit),
- double storage.

9.3.3.2 The checking of the validity of calculations shall be of type P. This consists in checking the correct value of all data related to the measurement whenever these data are internally stored or transmitted from/to peripheral equipment through an interface; this checking may be carried out by such means as parity bit, check sum or double storage.

In addition, the calculation system shall be provided with a means of controlling the continuity of the calculation program.

9.3.4 Checking facility for the indicating device

The objective of this checking facility is to verify that the primary indications are displayed and that they correspond to the data provided by the calculator. In addition, it aims at verifying the presence of the indicating devices, when they are removable.

The control may be performed according to either the first approach in 9.3.4.2 or the second approach in 9.3.4.3.

9.3.4.1 Unless the presence and the efficiency of the checking facility is ensured by the conformity to type, it shall be possible during verifications to determine that the checking facility of the indicating device is working, either:

- by disconnecting all or part of the indicating device, or by
- an action which simulates a failure in the display, such as using a test button.

9.3.4.2 First approach

This checking consists in checking the complete indicating device.

The checking facility of the indicating device is of type P. However, it may be of type I if a primary indication is provided by another device.

Means may include, for example:

- for indicating devices using incandescent filaments or LEDs, measuring the current in the filaments,
- for indicating devices using fluorescent tubes, measuring the grid voltage, or,
- for indicating devices using multiplexed liquid crystals, output checking of the control voltage of segment lines and of common electrodes, so as to detect any disconnection or short circuit between control circuits.

9.3.4.3 Second approach

First, the checking facility for the indicating device shall include type I or type P checking of the electronic circuits used for the indicating device (except the driving circuits of the display itself). The type I may be used if a primary indication is provided by another device.

Second, the checking facility for the indicating device shall include a type N checking for the display.

This control shall have the following characteristics:

- display of all elements ("eight" tests),
- extinction of all elements ("white"),
- display of the "zeros" or,
- any other sequence of automatic tests showing all possible states for each element of the display.

9.3.5 Checking facilities for ancillary devices

An ancillary device (repeating device, printing device, memory device, etc.) with primary indications shall include a checking facility of type I or P. The object of this checking facility is to verify the presence of the ancillary device, when it is a necessary device, and to verify the correct transmission of data between the calculator and the ancillary device.

In particular, the checking of a printing device aims at ensuring that the printing controls correspond to the data transmitted by the calculator. At least the following shall be checked:

- presence of paper,
- the electronic control circuits (except the driving circuits of the printing mechanism itself).

It shall be possible during type approval to check that the checking facility of the printing device is functioning by an action simulating a printing fault, such as using a test button. This checking shall be also possible at initial verification unless the presence and the efficiency of the checking facility is ensured by the conformity to type.

In the case of a memory device the correct memorising shall be checked.

Where the action of the checking facility is a warning, this shall be given on or by the ancillary device concerned.

9.3.6 Checking facilities for the associated measuring instruments

Associated measuring instruments shall include a checking facility of type P. The aim of this checking facility is to ensure that the signal given by these associated instruments is inside a pre-determined measuring range.

Note: This provision is not linked with the value of the significant fault but is provided in order to provide durability.

As long as a defective operation is detected by the checking facility, any further increase of the converted quantities shall not be permitted. However it is allowed to calculate separately an informative converted value when the signal given by the associated instruments is outside a pre-determined measuring range.

The volume at metering conditions and the corrected volume if it is included shall always increase.

In case where associated measuring instruments perform calculations, in particular calorific value determining devices, provisions in 9.3.3 apply in addition.

9.3.7 Checking facility for the control of the flow control equipment

Provisions in 9.3.6 apply to the control of flow control equipment.

10 Metrological control

10.1 General

10.1.1 A measuring system shall always be examined on site of use. In any case the measuring system in use has to fulfil or has to be assumed fulfilling the applicable requirements.

This should lead to perform tests on site too. However, in particular in the case of a meter or a metering module, tests on site are in general difficult or impossible to perform. For this reason, the National Authority may decide that tests are performed in laboratory. This Recommendation has been established (in particular Annex B) in order to give confidence in measurements on site even if some tests are not performed on site.

Also it has to be noticed that according to current practices, the verification of energy may only be performed on the basis of separate verifications of modules. This modular approach leads to verify in laboratory or on site according to what is the most appropriate for each module (see Annex C):

- the meter taking into account the conditions of installation of the meter into the system, that is the metering module,
- if applicable the device converting the quantity at metering conditions into a volume at base conditions or a mass,
- if applicable the device used to determine the calorific value,
- if applicable the device converting the volume at base conditions or the mass in energy.

10.1.2 When a test is conducted, the expanded uncertainty U (for $k=2$) for the determination of errors on indications of volume or mass, shall be less than one-third of the maximum permissible error applicable at type approval, at initial and subsequent verifications. However the uncertainty needs never to be less than 0.3 %.

Note: This last figure leads to a ratio uncertainty/MPE which can be considered large in legal metrology for type approval but which corresponds to the state of the art for calibration in gas metering and to the need of industry even if may lead to a false idea of actual accuracy taking into consideration uncertainties. Moreover:

- often the standard used for adjustment is the one used for verification,
- MPE apply to errors after adjustment using WME or correction.

This limits the risk of unduly refusal of correct instruments.

For the determination of errors on indications of calorific value the expanded uncertainty shall be less than one-third of the maximum permissible error applicable at each stage of the metrological control.

The estimation of expanded uncertainty is made according to the Guide to the expression of uncertainty in measurement (1995 edition).

As far as necessary, the working standards and their use will be the subject of specific International Recommendations.

10.2 Type approval

10.2.1 General

Measuring systems subject to a legal metrological control shall be subject to type approval.

The type approval of a measuring system is a general concept because a system may involve components very far away from the meter, which may be shared with other systems. It may involve also documented provisions. This is true in particular for a Class C measuring system. In any case, type (or unit) approvals for the complete systems shall be granted after having verified that the requirements specified in this Recommendation are fulfilled for the system. However this shows that the concept of measuring system may be very abstractive and in some cases the type approval certificate may be replaced by any suitable document providing the authorisation required by the law.

Moreover, the elements of a measuring system, and more particularly those mentioned in the list below, may be the subject of a separate approval (either according to this Recommendation or to specific recommendations or to the approval certificate of the measuring system):

- metering module;
- electronic calculator associated with indicating device;
- indicating device;
- conversion device;
- pressure associated measuring instrument ;
- temperature associated measuring instrument ;
- density associated measuring instrument ; and,
- calorific value determining device.

However it is considered that type approval of a temperature sensor conforming to IEC 751/A2 is not necessary.

As far as possible information on compatibility of a device with other ones is provided in the type approval certificate.

10.2.2 Documentation

10.2.2.1 The application for type approval of a measuring system or a constituent element of a measuring system shall be accompanied by the following documents:

- a description of the technical features and the operating principle;
- a drawing or a picture;
- process instrumentation diagrams;
- a part list (with the description of these parts' constituent materials when they are relevant on metrological level);
- a diagram for assembly (with identification of the constituent elements);
- for the measuring system, the references to the type approval certificates of the constituent elements, if any;
- for a measuring module and a meter equipped with a correction device, a description of the means used to determine the correction parameters;
- a diagram showing the locations of seals and verification marks;
- a plan of the prescribed inscriptions;
- for a CVDD, adjustment procedures;
- documented provisions; and,
- any document or proof supporting the assumption that the design and construction of the measuring system meet the requirements of this Recommendation.

10.2.2.2 In the case of an electronic measuring system, the application shall also include :

- when provided, a description of the electronic seals;
- a functional description of the various electronic devices;
- a flow chart of the software, explaining how the electronic devices work.

10.2.2.3 The applicant shall provide the organisation responsible for the examination with an instrument representing the final model or access to the complete installation.

10.2.3 Type approval certificate

The type approval certificates shall bear the following information:

- name and address of the beneficiary of the type approval certificate ;
- name and address of the manufacturer, if he is not the beneficiary ;
- type and/or trade name ;
- main metrological and technical features ;
- type approval mark;
- period or limit of validity ;
- rated operating conditions ;
- specific conditions for initial and subsequent verifications if applicable ;
- information on location of type approval marks, initial verification marks and sealing (for example picture or drawings) ;
- list of the documents accompanying the type approval certificate ;
- special remarks.

When applicable, the version of the metrological part (the complete part if there is no specific metrological part) of the evaluated software shall be indicated in the type approval certificate or in its annexes.

10.2.4 Modification of an approved pattern

The beneficiary of the type approval shall inform the body that granted the approval of any modification or any addition to an approved model.

Modifications or additions shall be the subject of a supplementary approval when they influence or might influence the measuring results or the metrological characteristics.

The organisation in charge of the approval of the modified pattern has to consider the nature of the modification and the initial folder when deciding whether and to which extent the applicable examinations and tests have to be performed on the modified pattern. A new or supplementary type approval shall be issued whenever the modified measuring system or device no longer fulfils the provisions of the initial approval certificate.

10.2.5 Type approval of a measuring system

Type approval of a measuring system comprises checking whether the constituent elements of this system satisfy the applicable requirements (even if type approval is not requested for the constituent elements) and that these constituent elements are compatible with one another. For instance the performance tests on accuracy of a calculator have to be performed in any case when a device includes a calculator.

Tests for carrying out the type approval of a measuring system shall therefore be determined on the basis of the type approvals (or evaluation) already granted for the constituent elements of the system.

When none of the constituent elements has been subject to separate type approval, all the applicable tests provided for in 10.2.6 to 10.2.12 shall be performed on the whole measuring system. On the contrary, when the various constituent elements are all approved separately, it is possible to replace type approval based on tests by type approval on drawings and design.

It is also appropriate to reduce the type evaluation program when the measuring system includes constituent elements identical to those which equip another measuring system that has already been approved, and when the operating conditions of these elements are identical.

Note: It is advisable that constituent elements be subject to separate type approval when they are intended to equip several patterns of measuring systems. This is particularly advisable when the various measuring systems have different manufacturers and when the bodies in charge of type approval are different.

When the measuring system involves documented provisions, appropriate analysis and investigations are implemented.

10.2.6 Type approval of a metering module

A metering module shall fulfil all requirements applicable to the hydraulic part of the measuring system including the meter in particular, laid down in this Recommendation. In particular, the liaison between a meter and an electronic device shall be secured with checking facilities.

The philosophy of the modular approach specified in 10.1.1 is applicable.

The following examinations and tests shall be carried out on the metering module.

The metering module shall be fitted with all ancillary devices likely to influence the accuracy of the metering module. The flow measuring device may also be tested without the calculator and the indicating device, provided they have been subject to a separate type approval. If this flow measuring device is intended to be connected to a calculator fitted with a correction device, the correction algorithm as described by the manufacturer must be applied to the output signal of the measuring transducer to determine its errors.

10.2.6.1 Accuracy tests at nominal operating conditions

At nominal operating conditions as declared by the manufacturer, the errors of the metering module shall be determined at a minimum of seven flowrates which are distributed over the measuring range at appropriate intervals (e.g. Q_{\min} , 5, 15, 25, 40, 70, 100 % of Q_{\max}). At each flowrate the errors shall be determined at least three times, independently and consecutively.

Each individual error shall be recorded in order to calculate the global error of the metering module at metering conditions, taking into account tests referred in 10.2.6.2 and laid down in Annex B.

Moreover the results of accuracy tests at nominal operating conditions shall meet the requirement on repeatability in 6.6.

10.2.6.2 Accuracy tests at metering conditions

10.2.6.2.1 Tests laid down in Annex B shall be performed.

10.2.6.2.2 Moreover and when applicable results of tests performed according to 10.2.6.1 and 10.2.6.2.1 are taken into account for determining MPEs at the first stage of initial verification, according to B.6.1.

10.2.6.2.3 Tests in real situation of use may be necessary according to the technology and the policy of the legal authority. These tests are mandatory for meters of another technology than those considered in Annex B.

10.2.6.2.4 Endurance test should be carried out using the gas the metering module is intended to measure or a gas with similar effects considering endurance. When the metering module is intended to measure two or more gases, the test should be carried out with the gas that provides the most severe conditions. However any other gas may be used provided it can be demonstrated that the test is equivalent.

The test may be performed on the meter alone if it can be assumed that other parts of the metering module will not influence the test result.

An accuracy test shall precede the endurance tests.

In principle the duration of the endurance test shall be 2000 hours in one or several periods not extending over a period of 120/150 days.

The test shall be carried out at a flowrate between $0.8 \times Q_{\max}$ and Q_{\max} .

As far as possible, the metering module is subjected to the endurance tests on a test bench. However, it is accepted that the metering module be temporarily mounted in a measuring system in normal operation, in which case it is necessary that the nominal operating flowrate of the metering module is more than $0.8 \times Q_{\max}$.

After the endurance test, the metering module is again subject to a new accuracy test. The deviations between the mean value of errors determined before and after the endurance test shall remain within the limits specified in 6.7 without any changes of the adjustment or corrections.

10.2.6.2.5 When the metering module is fitted with electronic components, it is also necessary to perform examinations and tests described in subclause 10.2.11 for electronic devices.

10.2.7 Type approval of a calorific value determining device

In order to verify a CVDD fulfils the applicable requirements, it is subject to the following provisions.

Prior to the tests the CVDD is adjusted according to the manufacturer's procedure.

As far as applicable (see 8.8.3), in the course of tests the CVDD is readjusted according to the adjustment interval and the adjustment procedure specified by the manufacturer. Any adjustment is recorded and shall be mentioned in the test report.

10.2.7.1 Performance tests under reference conditions

As a general rule tests shall be carried out using a minimum of six test gases of traceable and certified calorific value. The range of calorific values of these test gases should be wider than the required operational range; it would be normal for one test gas calorific value to be slightly lower than the minimum of the operational range and for one to be slightly higher than the maximum value of the operational range. Other gases shall be regularly spaced in the measuring range.

The accuracy of the CVDD shall be conforming to the requirements in Table 2. However if this provision is not fulfilled for the calibration gases having values slightly outside the operational range, the corresponding tests may be restarted in order to better suit this range.

10.2.7.2 Performance tests under influence quantities

These tests aim at verifying that the complete CVDD complies with the provisions in subclause 9.1.1 and 9.1.2 with regard to influence quantities.

These tests are specified in Annex A.

a) Performance under the effect of influence factors:

Tests are performed using at least one gas whose calorific value or composition differs the most of the one of the gas(es) used for the adjustment, as far as available.

When submitted to the effect of influence factors as provided for in Annex A, the equipment shall continue to operate correctly and the errors shall not exceed the applicable maximum permissible errors.

b) Performance under the effect of disturbances:

Tests are performed using one gas within the measuring range.

When submitted to external disturbances as provided for in Annex A, significant faults shall not occur.

10.2.7.3 Repeatability

The tests are carried out using gases of constant calorific value, or constant composition as the case may be, but not necessarily of certified value.

Three gases are used, one close to the lowest calorific value, one close to the highest calorific value and one approximately at the middle of the range. At least five (and normally not more than ten) measurements are performed with each gas.

The three repeatability errors so determined shall fulfil the requirement in 6.4.2.

10.2.7.4 Adjustment interval and drift

The verification of the adjustment interval is made using the same gas at the beginning and the end of the adjustment interval.

The same gases than those referred for repeatability tests are used.

The drift shall fulfil the requirement in 6.4.3. The tolerance applies to the mean value of three measurements.

10.2.7.5 Influence of the gas composition

The test shall be performed using at least two gases of different compositions having approximately the same calorific value. These gases may be used for accuracy tests laid down in 10.2.7.1 in particular.

The difference of the calorific values is within 3% and the variation of mole fractions of the main component has to be higher than 5%.

Three calorific value measurements are performed with each gas. For each gas the mean value of the three results is calculated.

The difference between the conventional true value for gas 1 and the conventional true value for gas 2 is calculated.

The difference between the mean value for gas 1 and the mean value for gas 2 is calculated.

The algebraic difference between these two differences shall fulfil the requirement in 6.4.4.

Repeat and adapt the procedure if more than two gases are used.

10.2.7.6 Response time

The gases used are the two used for tests in 10.2.7.1 having the largest different calorific values. One is supplied at the input of the CVDD for at least three measurements in order to get stabilised results.

Then the CVDD is immediately supplied with the other gas in order to perform the number of necessary measurements.

If the conclusion could be order dependent the test shall be repeated changing the order of the gases.

The CVDD shall fulfil the requirement in 6.4.5. After the given time, at least three measurements are performed. Each individual measurement shall fulfil the requirement.

10.2.7.7 Influence of gas supply

The influences of supply gas(es) pressure and flowrates are tested using two of the test gases in 10.2.7.1 having the largest different calorific values.

Tests are performed for extreme conditions of supply specified by the manufacturer. When one parameter is tested, the other ones are at nominal operating conditions.

When submitted to the effect of these influence factors, the equipment shall continue to operate correctly and the errors shall not exceed the applicable maximum permissible errors.

10.2.7.8 Specific tests for calorimeters

10.2.7.8.1 Influence of atmospheric pressure

The influence of atmospheric pressure is tested in conditions laid down in a) in 10.2.7.2.

When submitted to the effect of this influence factor, the equipment shall continue to operate correctly and the errors shall not exceed the applicable maximum permissible errors.

10.2.7.8.2 Installation effects

Concerning air movements there is no test to perform if the manufacturer declares that the calorimeter has to be installed in ambiances without air movements. If the manufacturer specifies other conditions, tests with the gases specified in 10.2.7.7 have to be performed in appropriate conditions.

Corresponding ambient conditions are specified in the type approval certificate.

When submitted to the effect of these influence factors, the equipment shall continue to operate correctly and the errors shall not exceed the applicable maximum permissible errors.

10.2.7.9 Specific provisions for gas chromatographs

For gas chromatographs the tests as described in 10.2.7.1 shall be carried out using at least seven test gases of traceable and certified composition. The concentration range for each component should be wider than the required operational ranges; it would be normal for each component to be tested at one concentration slightly lower than the specified minimum value and at one concentration slightly higher than the specified maximum value except where this concentration is 100 %.

However if the requirement is not fulfilled for the calibration gases having values slightly outside the operational range, the corresponding tests may be restarted in order to better suit this range.

10.2.7.10 Additional tests for other influences

As far as necessary, additional tests are performed according to the state of the art and provisions in 6.4.9.

10.2.8 Type approval of a volume conversion device

10.2.8.1 There are three ways to verify the conformity of a volume conversion device.

10.2.8.1.1 The first way corresponds to 6.3.3.1 and consists in verifying separately:

- 1 The accuracy of associated measuring instruments (see Table 3-1 in 6.3.3.1.1). Each quantity representative of the gas is varied separately. The tests involve fuel gas or any appropriate substitute method.
- 2 The accuracy on the calculation of each characteristic of the gas (see 6.3.3.1.2 and 10.2.10.2). Each quantity representative of the gas is varied separately.
- 3 The accuracy on the calculation of volume at base conditions or mass (see 6.5 and 10.2.10.2). All combinations of the measured quantities representative of the gas may be tested and, at least combinations of extreme values.
- 4 It is also necessary to perform examinations and tests described in subclause 10.2.11 for electronic devices.

It is possible to limit tests on influence factors to the worse cases of combinations anticipated from tests 1 to 3.

In principle tests on disturbances are performed for one combination of the quantities representative of the gas.

10.2.8.1.2 The second way corresponds to 6.3.3.2 and consists in verifying separately :

- 1 The accuracy of associated measuring instruments (see Table 3-1 in 6.3.3.1.1). Each quantity representative of the gas is varied separately. The tests involve fuel gas or any appropriate substitute method.
- 2 As the values processed by the conversion device are those delivered by the digital associated measuring instruments, the verification of the accuracy on the calculation of each characteristic of the gas is not relevant.
- 3 The accuracy on the calculation of volume at base conditions or mass (see 6.5 and 10.2.10.2). All combinations of the measured quantities representative of the gas may be tested and, at least combinations of extreme values.
- 4 It is also necessary to perform examinations and tests described in subclause 10.2.11 for electronic devices.

It is possible to limit tests on influence factors to the worse cases of combinations anticipated from tests 1 and 3.

In principle tests on disturbances are performed for one combination of the quantities representative of the gas.

10.2.8.1.3 The third way corresponds to 6.3.3.3 and consists in verifying that the conversion device connected to all its associated measuring instruments complies with the provisions of Table 3-2. For that purpose, the volume at metering conditions that is converted is considered to be without error. The procedure involves the following tests.

- 1 Tests at reference conditions.

All influence factors are at reference conditions and all combinations of the measured quantities representative of the gas may be tested, and at least combinations of extreme values.

In the case of a type of conversion other than a conversion only as a function of temperature, at least 3 gases of different compositions shall be used in order to evaluate the influence of the compressibility factors.

2 Tests at rated operating conditions

a) Conversion device performing conversion only as a function of temperature. Each influence factor is varied separately. The tests are performed for the extreme values of the temperature of the gas and the nominal value.

b) For other conversion devices, each influence factor is varied separately. All combinations of the measured quantities representative of the gas may be tested, and preferably combinations of extreme values. However it is possible to limit tests on influence factors to the worse cases of combinations anticipated from tests in 1 and/or of types of gas.

3 Tests for electronic devices

It is also necessary to perform examinations and tests on disturbances described in subclause 10.2.11 for electronic devices.

In principle tests on disturbances are performed for one combination of the quantities representative of the gas.

10.2.8.2 As far as necessary the type approval certificate provides information on the compatibility of the output of the meter and the input of the conversion device and with associated measuring instruments.

10.2.9 Type approval of an energy conversion device

Type approval of an energy conversion device necessitates:

- to verify that provisions in 10.2.10.1 are fulfilled;
- to perform examinations and tests described in subclause 10.2.11 for electronic devices;
- to identify the necessary conditions of compatibility applicable to the associated CVDDs or the list of these CVDDs.

Note: In general CVDDs are approved separately.

The quantity that is converted is considered to be without error.

10.2.10 Type approval for an electronic calculator

Type approval tests are conducted on the calculator alone, simulating different inputs with appropriate standards.

10.2.10.1 The accuracy tests include all of the tests to ensure the accuracy of the measuring result indications (volume at metering conditions, direct mass or energy).

True values are calculated on the basis of the simulated quantities applied to the calculator's inputs and using standardised methods for the calculations as far as necessary or they exist. The maximum permissible error is as set forth in subclause 6.5.

10.2.10.2 When the calculator performs calculations for a volume conversion device, in the case of a modular approach, the tests stated in subclause 10.2.10.1 are carried out for the calculation of volume at base conditions or mass.

In the case of the first modular approach, accuracy tests also include an accuracy test on the measurement of each characteristic quantity of the gas. For this purpose, the error obtained on the indication of each of these characteristic quantities (these indications are mandatory considering subclause 8.5.1) is calculated by considering the conventional true value as provided by the standard connected to the inputs of the calculator and which simulates the corresponding associated measuring instrument. For each of these quantities, the maximum permissible errors are as set in subclause 6.3.3.1.2.

It is then necessary to perform a test to check the presence and operation of the checking facilities relevant to associated measuring instruments mentioned in subclause 9.3.6.

10.2.10.3 Examinations and tests described in subclause 10.2.11 for electronic devices shall be performed.

10.2.11 Type approval for an electronic device

In addition to the examinations or tests described in the preceding subclauses, an electronic measuring system or an electronic constituent element of this system shall be subject to the following examinations and tests.

Note: Concerning software the work of OIML TC 5/SC 2 must be taken into consideration. In case this SC has not yet provided appropriate documents, National authorities shall implement appropriate provisions.

10.2.11.1 Design examination

Documents shall be examined to determine whether the design of electronic devices and their checking facilities comply with the requirements of this Recommendation.

The examination includes:

- a) examining the mode of construction of the electronic sub-systems and components, to verify their appropriateness for their intended use;
- b) considering the faults that are likely to occur in order to verify that in all considered cases these devices will comply with all requirements in subclause 9.3 and;
- c) verifying the presence and effectiveness of the test device(s) for the checking facilities.

10.2.11.2 Performance tests

These tests aim at verifying that the measuring system or the device complies with the provisions in subclause 9.1.1 and 9.1.2 with regard to influence quantities. These tests are specified in Annex A.

- a) Performance under the effect of influence factors:

When submitted to the effect of influence factors as provided for in Annex A, the equipment shall continue to operate as designed and the errors shall not exceed the applicable maximum permissible error.

- b) Performance under the effect of disturbances:

When submitted to external disturbances as provided for in Annex A, significant faults shall not occur.

10.2.11.3 Equipment under test (EUT)

The electronic devices shall be submitted separately for testing and shall comprise, as far as metering modules are concerned, at least the following devices:

- flow measuring device;
- calculator;
- indicating device;
- power supply; and,
- correction device, if any.

This equipment has to be included in a system enabling a representative simulation of the normal operation of the measuring system. For example, an appropriate device may simulate the gas movement.

The peripheral equipment may be tested separately.

CVDDs are tested as a whole.

10.2.12 Type approval for ancillary device

10.2.12.1 When an ancillary device that repeats primary indications is intended to be approved separately, its indications shall be compared with those provided by an indicating device that has already been approved and which has the same scale interval, or a smaller one. The results shall satisfy the provisions in subclause 7.1.4.5.

As far as necessary, conditions for compatibility with other devices of a measuring system are stated in the type approval certificate.

10.2.12.2 Electronic devices may be approved separately when they are used for the transmission of primary indications or other necessary information. For example a device which receives information from two or more calculators and transmits it to a single printing device.

When at least one of the signals of this information is analogue, the device shall be tested in association with another device whose maximum permissible errors are provided by this Recommendation.

When all the signals of this information are digital, the above provision may be applied; however, when the inputs and outputs of the device are available, the device may be tested separately, in which case, no error shall be introduced; only errors due to the testing method may be found out.

In both cases and as far as necessary, the necessary conditions for compatibility with other devices of a measuring system are stated in the type approval certificate.

10.3 Initial verification

The initial verification consists in verifying that the measuring system fulfils the full set of metrological requirements applicable to the measuring system on site of use.

Note: This does not mean that each provision in this Recommendation is checked at initial verification and that each test or examination is performed on site of use (see 10.1.1).

10.3.1 Initial verification of a metering module

10.3.1.1 Excepted when the type approval certificate provides specific provisions the initial verification of a metering module is performed :

- on the complete flowrate range of the metering module,
- under rated operating conditions (pressure, temperature...),
- with gas(es) to be measured.

When the type approval certificate provides specific provisions, as far as necessary, it provides also any correction and/or condition to be applied.

10.3.1.2 There are several ways to get the assurance that the metering module fulfils the full set of requirements.

The ideal way consists in performing the complete verification on the actual site of use.

However all tests may be not possible in actual site of use: for instance every actual flowrates may be not achievable the day of verification. In this case it is necessary to perform the verification in two stages.

Moreover tests (or some tests) in actual site of use are not necessary when it can be demonstrated that the corresponding tests performed on a test bench are representative of the actual situation and when the behaviour of the system is not likely to be influenced by disassembling, transportation and reassembling. In this case the second stage of the verification, if appropriate, does not need to include tests (or all tests) but may only consist in an examination.

In any case, for technologies which are not mentioned in Annex B the initial verification shall always include a metrological evaluation on the actual site of use.

10.3.1.3 In the case of a first stage of the verification, as far as possible, the separate verification of the flow measuring device and of the calculator may be considered.

In any case any ancillary or additional device likely to influence the performance of the system shall be present at each stage of the verification.

10.3.1.4 The initial verification includes correction as close as possible to zero of individual errors by means of the correction device or of the WME by means of the adjustment device. After correction or adjustment, all errors shall be or shall be able to be considered within MPEs. After correction or adjustment it is advisable to perform a new test in order to confirm the correction or adjustment.

However it is possible to consider that it is not necessary to adjust the WME when the set of following conditions is met:

- in case of the first stage of a verification and;
- it is intended to perform a second stage of verification including accuracy tests in actual site and;
- the error curve is within a range corresponding to the range of applicable MPEs.

Then all errors are registered and the WME has to be adjusted at the second stage of verification and the here-above requirement is checked.

In the case of a correction device and when correction parameters are determined at the first stage of the verification, the presence of these parameters in the correction device shall be checked at the second stage of verification.

10.3.2 Initial verification of conversion devices

The initial verification of conversion devices is performed in one or two stages.

In any case it includes at least examination in actual site of use.

The compliance with the requirements shall be checked after adjustment of the instrument.

Several calibration gases shall be used with calorific values equally spaced on the long-term CV-range for the installation site.

10.3.3 Initial verification of a measuring system

The initial verification includes here-after tests and examinations performed according to the provisions in 10.3.1 and 10.3.2:

- 1 An examination of the conformity of the measuring system and of all its elements;
- 2 A metrological testing and examination of the metering module;
- 3 A metrological testing and examination of the volume conversion device and of relevant associated measuring instruments, if applicable;
- 4 A metrological testing and examination of the energy conversion device and of the calorific value determining device, if applicable;
- 5 An examination of the suitability of documented provisions, if applicable.

10.4 Subsequent verifications

Subsequent verifications may be identical to initial verification.

10.5 Documented provisions, quality assurance systems and routine controls

10.5.1 According to the definition of a measuring system a documented provisions system may be considered as integral parts of the measuring system (see E.1).

Moreover a quality assurance system may be considered as essential to ensure the correct use and the fundamental integrity of the installation. This may be particularly important for the calibration and the maintenance of calorific value determining devices when they are subject to calibration procedures by the user. During operation, the fundamental integrity shall be preserved.

When documented provisions and if applicable the quality assurance system are necessary for ensuring the performance and/or the integrity of the measuring system, they shall be part of the measuring system and mandatory provisions, and shall be enforced as such.

10.5.2 The documented provisions, the quality assurance system or the regulation may foresee that routine tests are performed. The results of the routine tests shall be compared to pre-established limits and the differences shall results into appropriate reactions.

ANNEX A

PERFORMANCE ENVIRONMENTAL INFLUENCE TESTS FOR ELECTRONIC MEASURING SYSTEMS OR DEVICES

(Mandatory)

A.1 General

This annex defines the program of performance tests intended to verify that electronic measuring systems or electronic devices may perform and function as intended in a specified environment and under specified conditions. Each test indicates, where appropriate, the reference conditions for determining the intrinsic error.

These tests supplement any other prescribed test.

When the effect of one influence quantity is being evaluated, all other influence quantities are to be held at values within the limits of reference conditions.

A.2 Severity levels (see OIML D 11)

For each performance test, typical test conditions are indicated: they correspond to the climatic and mechanical environment conditions to which measuring systems are usually exposed.

Measuring systems are divided into two classes according to climatic and mechanical environmental conditions:

- class I for fixed instruments or devices installed in a building,
- class O for fixed instruments or devices installed outdoors,

However, the applicant for type approval may indicate specific environmental conditions in the documentation supplied to the metrology service, based on the intended use of the instrument or devices. In this case, the metrology service carries out performance tests at severity levels corresponding to these environmental conditions. If type approval is granted, the data plate shall indicate the corresponding limits of use. Manufacturers shall inform potential users of the conditions of use for which the instrument is approved. The metrology service shall verify that the conditions of use are met.

A.3 Reference conditions

Ambient temperature	:	20 °C ± 5 °C
Temperature of the gas 1) 2)	:	Nominal operating conditions declared by the manufacturer ± 5 °C
Relative humidity	:	60 % ± 15 %
Atmospheric pressure	:	86 kPa to 106 kPa
Power voltage	:	Nominal voltage (U_{nom})
Power frequency	:	Nominal frequency (f_{nom})
Flowrate (if relevant)	:	0.95 x Q_{max} to Q_{max}

- 1) For parts of the metering module that necessitate to be tested with gas
- 2) Substitute gas may be used for security reasons

During each test, the temperature and relative humidity shall not vary by more than 5 °C or 10 % respectively within the reference range.

A.4 Performance tests

The following tests can be carried out in any order.

Test		Nature of the influence quantity	Severity level for class (referring to D 11)	
			I	O
A.4.1	Dry heat	Influence factor	2	3
A.4.2	Cold	Influence factor	2	3
A.4.3.a	Damp heat, steady state	Influence factor	1	2
A.4.3.b	Damp heat, cyclic	Disturbance	1	2
A.4.4	Vibration (random)	Influence factor	1	1
A.4.5.a	Radiated, radio frequency electromagnetic fields of general origin	Disturbance	3	3
A.4.5.b	Radiated, radio frequency electromagnetic fields caused by digital radio telephones	Disturbance	3	3
A.4.6	Conducted radio frequency fields	Disturbance	3	3
A.4.7	Electrostatic discharge	Disturbance	3	3
A.4.8	Surges on signal, data and control lines	Disturbance	3	3
A.4.9	DC mains voltage variation	Influence factor	-	-
A.4.10	AC mains voltage variation	Influence factor	1	1
A.4.11	AC mains voltage dips, short interruptions, and voltage variations	Disturbance	2	2
A.4.12	Bursts (transients) on AC and DC mains and on signal lines	Disturbance	3	3
A.4.13	Surges on AC and DC mains power lines	Disturbance	3	3
A.4.14	Voltage of internal battery	Influence factor	1	1

For EMC tests the severity levels are those corresponding to industrial environments.

The above tests involve the electronic part of the measuring system or its devices.

The following rules shall be taken into consideration for these tests:

1) Test quantities

Some influence quantities are likely to have a constant effect on measurement results and not a proportional effect related to the measured quantity. The value of the significant fault is related to the measured quantity; therefore, in order to be able to compare results obtained in different laboratories, it is necessary to perform a test on a quantity corresponding to that delivered in one minute at the maximum flowrate, but not less than a quantity corresponding to the appropriate number of scale intervals specified in Annex F. Some tests, however, may require more than one minute, in which case they shall be carried out in the shortest possible time.

2) Influence of the gas temperature

Temperature tests concern the ambient temperature and not the temperature of the gas used. It is therefore advisable to use a simulation test method so that the temperature of the gas does not influence the test results.

3) Atmospheric pressure

The pressure shall be maintained in reference conditions for all the tests.

A.4.1 Dry heat

Applicable standards	IEC 60068-2-2 IEC 60068-3-1
Test method	Dry heat (non condensing)
Object of the test	To verify compliance with the provisions in 9.1.1 under conditions of high temperature
Test procedure in brief (*):	The test consists of exposure of the EUT to a temperature of 55 °C (class C) or 40 °C (class B) under "free air" conditions for a 2-hour period after the EUT has reached temperature stability. The EUT shall be tested at at least one flow rate (or simulated flowrate): <ul style="list-style-type: none"> • at the reference temperature of 20 °C following conditioning, • at the temperature of 55 °C or 40 °C, 2 hours after temperature stabilization, • after recovery of the EUT at the reference temperature of 20 °C.
Test severities:	1) Temperature: <ul style="list-style-type: none"> - severity level 2: 40 °C - severity level 3: 55 °C 2) Duration: 2 hours
Number of test cycles:	One cycle
Maximum allowable variations:	<ul style="list-style-type: none"> • All functions shall operate as designed and • all errors shall be within the maximum permissible errors.
(*) This test procedure has been given in condensed form, for information only, and is adapted from the referenced IEC-publication. Before conducting the test, the applicable publication should be consulted. This comment also applies to the test procedures hereafter.	

A.4.2 Cold

Applicable standards	IEC 60068-2-1 IEC 60068-3-1
Test method	Cold
Object of the test	To verify compliance with the provisions in 9.1.1 under conditions of low temperature
Test procedure in brief :	The test consists of exposure of EUT to a temperature of - 25 °C (class C) or - 10 °C (class B) under "free air" conditions for a 2-hour period after the EUT has reached temperature stability. The EUT shall be tested at at least one flow rate (or simulated flow rate): <ul style="list-style-type: none"> • at the reference temperature of 20 °C following conditioning, • at a temperature of - 25 °C or - 10 °C, 2 hours after temperature stabilization, • after recovery of the EUT at the reference temperature of 20 °C.
Test severities:	1) Temperature: <ul style="list-style-type: none"> - severity level 2: - 10 °C - severity level 3: - 25 °C 2) Duration: 2 hours
Number of test cycles:	One cycle
Maximum allowable variations:	<ul style="list-style-type: none"> • All functions shall operate as designed and • all errors shall be within the maximum permissible errors.

A.4.3 Damp Heat

A.4.3a Damp heat, steady state (non condensing)

Applicable standards	IEC 60068-2-78 IEC 60068-3-4			
Test method	Damp heat, steady-state			
Object of the test	<p>To verify compliance with the provisions in 9.1.1 under conditions of high humidity and constant temperature.</p> <p>The steady-state test should always be used where adsorption or absorption play the main part. When diffusion but not breathing is involved, either the steady-state or the cyclic test shall be applied depending on the type of EUT and its application.</p>			
Test procedure in brief :	The test consists of exposure of the EUT to the specified high level temperature and the specified constant relative humidity for a certain fixed time defined by the severity level. The EUT shall be handled such that no condensation of water occurs on it.			
Test severities:	Severity level	1	2	
	Temperature	30	40	°C
	Humidity	85	93	% rel
	Duration	2	4	days
Maximum allowable variations :	<p>After the application of the influence factor and recovery:</p> <ul style="list-style-type: none"> • all functions shall operate as designed and • all errors shall be within the maximum permissible errors. 			

A.4.3.b Damp heat, cyclic (condensing)

Applicable standards	IEC 60068-3-4 IEC 60068-2-30
Test method	Damp heat, cyclic
Object of the test	To verify compliance with the provisions in 9.1.1 under conditions of high humidity when combined with cyclic temperature changes. Cyclic tests shall be applied in all the cases where condensation is important or when the penetration of vapour will be accelerated by the breathing effect.
Test procedure in brief :	The test consists of exposure of the EUT to cyclic temperature variations between, 25 °C and the upper temperature of 55 °C (class C) or 40 °C (class B), maintaining the relative humidity above 95 % during the temperature changes and during the phases at low temperature, and at 93 % at the upper temperature phases. Condensation should occur on the EUT during the temperature rise. The 24 h cycle consists of: <ol style="list-style-type: none"> 1) temperature rise during 3 h 2) temperature maintained at upper value until 12 h from the start of the cycle 3) temperature lowered to lower value within 3 h to 6 h, the rate of fall during the first hour and a half being such that the lower value would be reached in 3 h 4) temperature maintained at lower value until the 24 h cycle is completed. <p>The stabilising period before and recovery after the cyclic exposure shall be such that all parts of the EUT are within 3 °C of their final temperature.</p> <p>The EUT is not under power when the disturbance is applied.</p>
Test severities:	1) Upper temperature : <ul style="list-style-type: none"> - severity level 1: 40 °C - severity level 2: 55 °C 2) Duration: 24 hours
Number of test cycles:	Two cycles
Maximum allowable variations :	After the application of the disturbance and recovery either the difference between any indication before the test and the indication after the test shall not exceed the values given in T.2.17 or the measuring system shall detect and act upon a significant fault, in compliance with 9.3.1.

A.4.4 Vibration (random)

Applicable standard	IEC 60068-2-64 IEC 60068-2-47		
Test method	Random vibration		
Object of the test	To verify compliance with the provisions in 9.1.1 under conditions of random vibration		
Test procedure in brief:	<p>The EUT shall, in turn, be tested in three, mutually perpendicular axes mounted on a rigid fixture by its normal mounting means.</p> <p>The EUT shall normally be mounted so that the gravitational force acts in the same direction as it would in normal use. Where the effect of gravitational force is not important the EUT may be mounted in any position.</p> <p>When the influence factor is applied, the EUT :</p> <ul style="list-style-type: none"> - is not under power, - is not mounted on a piping system, - is not put in any protection case. 		
Test severity:	Severity level	1	Unit
	Total frequency range	10-150	Hz
	Total RMS level	1.6	m.s ⁻²
	ASD level 10-20 Hz	0.05	m ² .s ⁻³
	ASD level 20-150 Hz	-3	dB/octave
	Duration per axis (or a longer period if necessary for carrying out the measurement)	2	min
Maximum allowable errors:	<p>After the application of the influence factor:</p> <ul style="list-style-type: none"> • All functions shall operate as designed and • all errors shall be within the maximum permissible errors. 		

A.4.5 Radio frequency immunity

Applicable standard	IEC 61000-4-3
Test method	Radiated electromagnetic fields
Object of the test	To verify compliance with the provisions in 9.1.2 under conditions of electromagnetic fields.
Test procedure in brief	<p>The EUT shall be exposed to electromagnetic field strength as specified by the severity level and a field uniformity as defined by the referred standard.</p> <p>The EM field can be generated in different facilities, however the use of which is limited by the dimensions of the EUT and the frequency range of the facility.</p>
Maximum allowable variations:	Either the difference between any indication during the test and the indication under reference conditions shall not exceed the values given in T.2.17 or the measuring system shall detect and act upon a significant fault, in compliance with 9.3.1

A.4.5.a Radiated, radio frequency, electromagnetic fields of general origin

Severity level		3	unit
frequency range	80 - 800 MHz	10	V/m
	960 - 1400 MHz	10	
Modulation	80 % AM, 1 kHz, sine wave		

A.4.5.b Radiated, radio frequency, electromagnetic fields caused by digital radio telephones

Severity levels		3	unit
frequency range	800 - 960 MHz	10	V/m
	1400 - 2000 MHz	10	
Modulation		80 % AM, 1 kHz, sine wave	

A.4.6 Conducted, radio frequency, electromagnetic fields

Applicable standard	IEC 61000-4-6		
Test method	Conducted electromagnetic fields		
Object of the test	To verify compliance with the provisions in 9.1.2 under conditions of electromagnetic fields.		
Test procedure in brief	Radio frequency EM current, simulating the influence of EM fields shall be coupled or injected into the mains and input ports of the EUT using coupling/decoupling devices as defined in the referred standard. The performance of the test equipment consisting of an RF generator, (de-)coupling devices, attenuators, etc. shall be verified.		
Severity levels	3	Unit	
RF amplitude (50 Ω)	10	V (e.m.f.)	
Frequency range	0,15 – 80		MHz
Modulation	80 % AM, 1 kHz sine wave		
Maximum allowable variations:	Either the difference between any indication during the test and the indication under reference conditions shall not exceed the values given in T.2.17 or the measuring system shall detect and act upon a significant fault, in compliance with 9.3.1		

A.4.7 Electrostatic discharge

Applicable standard	IEC 61000-4-2		
Test method	Electrostatic discharge (ESD)		
Object of the test	To verify compliance with the provisions in 9.1.2 under conditions of direct and indirect electrostatic discharges		
Test procedure in brief:	<p>An ESD generator shall be used with a performance as defined in the referred standard.</p> <p>Before starting the tests, the performance of the generator shall be verified.</p> <p>At least 10 discharges shall be applied. The time interval between successive discharges shall be at least 10 seconds.</p> <p>For EUT not equipped with a ground terminal, the EUT shall be fully discharged between discharges.</p> <p>Contact discharge is the preferred test method. Air discharges shall be used were contact discharge cannot be applied.</p> <p>Direct application:</p> <p>In the contact discharge mode to be carried out on conductive surfaces, the electrode shall be in contact with the EUT.</p> <p>In the air discharge mode on insulated surfaces, the electrode is approached to the EUT and the discharge occurs by spark.</p> <p>Indirect application:</p> <p>The discharges are applied in the contact mode to coupling planes mounted in the vicinity of the EUT.</p>		
Severity levels ⁽¹⁾	3		unit
Test voltage	contact discharge	6	kV
	air discharge	8	kV
Note	In this case, "level" means": up to and including the specified level" (i.e. the test shall also be performed at the specified lower levels in the standard)		
Maximum allowable variations :	Either the difference between any indication during the test and the indication under reference conditions shall not exceed the values given in T.2.17 or the measuring system shall detect and act upon a significant fault, in compliance with 9.3.1.		

A.4.8 Surges on signal, data and control lines

Applicable standard	IEC 61000-4-5	
Test method	Electrical surges	
Object of the test	To verify compliance with the provisions in 9.1.2 under conditions where electrical surges are superimposed on I/O and communication ports	
Test procedure in brief	<p>A surge generator shall be used with the performance characteristics as specified in the referred standard. The test consists of exposure to surges for which the rise time, pulse width, peak values of the output voltage/current on high/low impedance load and minimum time interval between two successive pulses are defined in the referred standard.</p> <p>The characteristics of the generator shall be verified before connecting the EUT. At least 3 positive and 3 negative surges shall be applied. The injection network depends on the lines the surge is coupled into and is defined in the referred standard.</p> <p>If the EUT is an integrating instrument (meter), the test pulses shall be continuously applied during the measuring time.</p>	
Severity level (Installation class)	3	unit
Unbalanced lines	Line to line	1.0
	Line to earth	2.0 ⁽¹⁾
Balanced lines	Line to line	N.A.
	Line to earth	2.0
Notes	⁽¹⁾ Normally tested with primary protection	
Maximum allowable variations :	After the application of the disturbance and recovery, either the difference between any indication before the test and the indication after the test shall not exceed the values given in T.2.17 or the measuring system shall detect and act upon a significant fault, in compliance with 9.3.1.	

A.4.9 DC mains voltage variation (if relevant)

Applicable standard	IEC 60654-2
Test method	Variation in DC mains power voltage
Object of the test	To verify compliance with the provisions in 9.1.1 under conditions of varying DC mains power voltage
Test procedure in brief	The test consists of exposure to the specified power supply condition for a period sufficient for establishing stability.
Test severity	<p>The upper limit will be the DC level at which the EUT has been manufactured to automatically detect high-level conditions.</p> <p>The lower limit will be the DC level at which the EUT has been manufactured to automatically detect low-level conditions.</p> <p>The EUT shall comply with the specified maximum permissible errors at voltage levels between the two levels.</p>
Maximum allowable variations:	<ul style="list-style-type: none"> • All functions shall operate as designed and • all errors shall be within the maximum permissible errors.

A.4.10 AC mains voltage variation

Applicable standards	IEC/TR3 61000-2-1 IEC 61000-2-2 IEC 61000-4-1
Test method	Variation in AC mains power voltage and frequency (single phase)
Object of the test	To verify compliance with the provisions in 9.1.1 under conditions of varying AC mains power voltage and frequency.
Test procedure in brief:	The test consists of exposure of the EUT to power voltage variations, while the EUT is operating under normal atmospheric conditions.
Test severities:	Mains voltage: upper limit: $U_{nom} + 10\%$ lower limit: $U_{nom} - 15\%$
Number of test cycles:	One cycle
Maximum allowable variations:	<ul style="list-style-type: none"> All functions shall operate as designed and all errors shall be within the maximum permissible errors.

A.4.11 AC mains voltage dips, short interruptions, and voltage variations

Applicable standards	IEC 61000-4-11 IEC 61000-6-1 IEC 61000-6-2				
Test method	Short-time reductions in mains voltage				
Object of the test	To verify compliance with the provisions in 9.1.2 under conditions of short time mains voltage reductions				
Test procedure in brief	<p>A test generator suitable to reduce for a defined period of time the amplitude of the AC mains voltage is used.</p> <p>The performance of the test generator shall be verified before connecting the EUT.</p> <p>The mains voltage reductions shall be repeated 10 times with an interval of at least 10 seconds.</p>				
Severity level	2			Unit	
Test	test a	test b	test c		
Voltage reduction	Reduction	0	0	70	%
	Duration	0.5	1	25/30	periods
Voltage interruption	Interruption	> 95			%
	Duration	250/300			periods
Maximum allowable variations:	Either the difference between any indication during the test and the indication under reference conditions shall not exceed the values given in T.2.17 or the measuring system shall detect and act upon a significant fault, in compliance with 9.3.1				
Notes:					
<p>The severity levels are an interpretation of IEC 61000-4-11 and according to IEC 61000-6-1 and IEC 61000-6-2.</p> <p>The value 0 as “reduction” does not mean that the reduction is nil. See the signification of this parameter in the appropriate standard.</p>					

A.4.12 Bursts (transients) on AC and DC mains and on signal lines

Applicable standards		IEC 61000-4-1 IEC 61000-4-4	
Test method		Electrical bursts	
Object of the test		To verify compliance with the provisions in 9.1.2 under conditions where electrical bursts are superimposed on the mains voltage and if applicable on input/output and communication ports.	
Test procedure in brief:		<p>A burst generator shall be used with the performance characteristics as specified in the referred standard.</p> <p>The test consists of exposure to bursts of voltage spikes for which the repetition frequency of the impulses and peak values of the output voltage on 50 Ω load are defined in the referred standard.</p> <p>The characteristics of the generator shall be verified before connecting the EUT.</p> <p>At least 10 positive and 10 negative randomly phased bursts shall be applied.</p> <p>The injection network on the mains shall contain blocking filters to prevent the burst energy being dissipated in the mains.</p> <p>For the coupling of the bursts into the input/output and communication lines, a capacitive coupling clamp as defined in the standard shall be used.</p>	
Severity levels		3	unit
Amplitude (peak value)	Supply lines ⁽¹⁾	2	kV
	Signal lines ⁽²⁾	1	kV
Repetition rate		5	kHz
Maximum allowable variations:		Either the difference between any indication during the test and the indication under reference conditions shall not exceed the values given in T.2.17 or the measuring system shall detect and act upon a significant fault, in compliance with 9.3.1	
Notes:			
<p>⁽¹⁾ Only for instruments powered by AC or DC mains power supply.</p> <p>⁽²⁾ I/O signal, data and control ports.</p>			

A.4.13 Surges on AC and DC mains power lines

Applicable standard	IEC 61000-4-5	
Test method	Electrical surges	
Object of the test	To verify compliance with the provisions in 5.1.1 or 5.1.2 under conditions where electrical surges are superimposed on the mains voltage	
Test procedure in brief	<p>A surge generator shall be used with the performance characteristics as specified in the referred standard. The test consists of exposure to surges for which the rise time, pulse width, peak values of the output voltage/current on high/low impedance load and minimum time interval between two successive pulses are defined in the referred standard.</p> <p>The characteristics of the generator shall be verified before connecting the EUT. On AC mains supply lines at least 3 positive and 3 negative surges shall be applied synchronously with AC supply voltage in angles 0°, 90°, 180° and 270°. On DC power lines, at least 3 positive and 3 negative surges shall be applied. The injection network depends on the lines the surge is coupled into and is defined in the referred standard.</p> <p>If the EUT is an integrating instrument, the test pulses shall be continuously applied during the measuring time.</p>	
Severity level (installation class)	3	unit
Line to line	1.0	kV
Line to earth	2.0	kV
Maximum allowable variations :	After the application of the disturbance and recovery, either the difference between any indication before the test and the indication after the test shall not exceed the values given in T.2.17 or the measuring system shall detect and act upon a significant fault, in compliance with 9.3.1	

A.4.14 Voltage of internal battery (if relevant)

Applicable standards	There is no reference to standards for this test.
Test method	Variation in supply voltage
Object of the test	To verify compliance with the provisions in 9.1.1 under conditions of low battery voltage
Test procedure	<p>The test consists of exposure to the specified condition of the battery(s) for a period sufficient for achieving temperature stability and for performing the required measurements.</p> <p>If an alternative power source (standard power supply with sufficient current capacity) is used in bench testing to simulate the battery, it is important that the internal impedance of the specified type of battery also be simulated.</p> <p>The maximum internal impedance of the battery is to be specified by the manufacturer of the instrument.</p> <p>Test sequence: Stabilize the power supply at a voltage within the defined limits and apply the measurement and/or loading condition. Record the following data:</p> <ol style="list-style-type: none"> a) date and time b) temperature c) power supply voltage d) functional mode e) measurements and/or loading condition f) indications (as applicable) g) errors h) functional performance <p>Reduce the power voltage to the EUT until the equipment clearly ceases to function properly according to the specifications and metrological requirements, and note the following data:</p> <ol style="list-style-type: none"> i) power supply voltage j) indications k) errors l) other relevant responses of the instrument
Lower limit of the voltage	The lowest voltage at which the EUT functions properly according to the specifications
Number of cycles	At least one test cycle for each functional mode
Maximum allowable variations:	<ul style="list-style-type: none"> • All functions shall operate as designed and • all errors shall be within the maximum permissible errors.

ANNEX B

INFLUENCE TESTS FOR TYPE APPROVAL FOR METERING MODULES

(Mandatory)

This annex provides the influence test conditions for a metering module and maximum allowable influences. These tests have to be performed for all technologies.

However tests for hydraulic influence are particularly adapted for the well known technologies considered in this annex, that is:

- turbine meters,
- rotary piston meters,
- orifice plate meters,
- ultrasonic meters,
- vortex meters,
- Coriolis mass meters.

It is the reason why the complete modular approach is only possible for these technologies. For other technologies tests on site are always necessary (in addition to the following) at type approval and initial verification. Nevertheless, as indicated in 10.2.6.2.3, the legal authority may require tests in real conditions of use for all technologies.

Moreover if provisions in clause B.2 are applicable to any metering module, some specific provisions may be applied for specific technologies or for particular cases as laid down in clause B.7

B.1 General provisions

According to the way the meter is installed, in particular the straight lengths of the pipe upstream of the meter, the same meter may belong to metering modules of different accuracy classes

The minimum straight lengths, other necessary conditions (presence of flow conditioner...) and the corresponding accuracy classes shall be indicated in the type approval certificate.

B.2 Pipework installation influence

B.2.1 The minimum straight lengths upstream of the meter shall be at least twice the nominal inlet diameter of the meter. The minimum straight lengths downstream of the meter shall be at least twice the nominal outlet diameter of the meter.

Note: These minimum values are considered in order to ensure the compatibility with the tests foreseen for application of **OIML R 32**; the effective minimum straight lengths shall be proposed by the manufacturer in accordance with the international standards and validated in the course of the evaluation process.

This Recommendation encourages the installation of pressure reducers downstream of meters. In any case, the type approval certificate of a metering module shall include information on the possibility or not of the presence of a pressure reducer upstream of a meter in conformity with the following:

- For a class A metering module, either a pressure reducer shall never be installed with an upstream straight length less than 50 times the nominal inlet diameter of the meter, or the metering module shall be tested with the actual intended type of pressure reducer at type approval and on site of installation at initial verification or after each maintenance operation likely to influence the metrological performances.

- For class B or C metering modules either a pressure reducer shall never be installed with an upstream straight length less than 10 times the nominal inlet diameter of the meter, or the metering module shall be tested with the actual intended type of pressure reducer and the type approval certificate shall indicate this actual intended type of pressure reducer and the effective upstream straight length.

These provisions apply without prejudice of B.7 for specific technologies.

B.2.2 The metering module shall be submitted to the following tests for the influence of flow disturbances with the corresponding devices upstream of the meter.

These tests are performed at stable gas pressure and temperature.

First test

The test configurations are those of point A.2.1 in [OIML R 32](#), except that according to the manufacturer choice, the upstream straight length can be greater than twice the inlet diameter of the meter.

The tests are performed for configurations a and b as indicated in [OIML R 32](#).

Second test

The test configuration is the one of point A.3.1 in [OIML R 32](#), excepted that according to the manufacturer choice, the upstream straight length can be greater than twice the inlet diameter of the meter.

Third test

The manufacturer shall specify the minimum distance at which a pressure reducer may be located upstream of the meter.

The third test is not applicable when this distance is greater than or equal to respectively 50 times the nominal inlet diameter of the meter for class A and 10 times the nominal inlet diameter of the meter for class B and C.

When the metering module needs to be tested, as a consequence of B.2.1, the pressure reducer is of the actual intended type.

The minimum distance and the intended effective type specified by the manufacturer are put in the type approval certificate.

The deviation of errors with and without the pressure reducer (without adjustment of the meter) shall be recorded.

Acceptance criteria

For the first and second tests if the metering module only consists in a meter and an upstream straight length of twice the inlet diameter (and the same for downstream), the maximum permissible influence, positive or negative, is 0.33 %.

The largest effective influence in absolute value for above tests is called ΔF hereafter in order to calculate the global influence as laid down in B.5. However the figures corresponding to the third test are not taken into consideration when the metering module is intended to be tested on site of installation with the presence of the effective pressure reducer.

Note: The metering module is made of the meter and straight lengths as declared by the manufacturer, tacking into account considerations on the presence of a pressure reducer as laid down above.

B.3 Influence of gas pressure

The metering module shall be submitted to a test for the influence of gas pressure. However in practice it is possible to perform this test on the meter alone if according to the technology of the meter it can be assumed that the conclusion of the test would be the same.

This test should be performed with gaseous fuel and at a stable gas temperature. However other gases may be used if the equivalency has been preliminary demonstrated.

Test

Its consists in determinations and comparisons of the error curve at the nominal gas pressure as declared by the manufacturer with the error curves at the lowest and the highest gas pressure as declared by the manufacturer.

Note: The test may be performed at a lower pressure than the highest pressure if it is established that it would not have a significant influence on the test result. However, a minimum test pressure of 20 bar is required (if the highest value is greater).

Acceptance criterion

The influence of gas pressure, positive or negative, shall not exceed 0.5 %. The larger effective influence in absolute value is called ΔP hereafter in order to calculate the global influence as laid down in B.5.

B.4 Influence of gas temperature

The metering module should be submitted to a test for the influence of gas temperature. This test called "basic test" should be performed with gaseous fuel at a stable gas pressure. However other gases might be used if the equivalency has been preliminary demonstrated.

Moreover, this test is not easy to perform in practice. As a consequence the following rules apply:

- 1 For technologies mentioned in introduction of this annex no test and no investigation are necessary when rated operating conditions for gas temperature are in the range 5 °C to 30 °C.
- 2 In all other cases it is allowed not to perform the basic test if the influence of gas temperature can be evaluated implementing any substitute testing and/or investigation.

If a test is performed (basic one or not), it is possible to do it on the meter alone if according to the technology of the meter it is established that the conclusion of the test would be the same.

Basic Test

It consists in determinations and comparisons of the error curve at the nominal gas temperature as declared by the manufacturer with the error curves at the lowest and the highest gas temperature as declared by the manufacturer.

Acceptance criterion

If the basic test is performed, the larger effective influence in absolute value is recorded and called ΔT hereafter in order to calculate the global influence as laid down in B.5.

If the basic test is not performed, any evaluation implementing any substitute testing and/or investigation shall lead to the conclusion that the influence of gas temperature should be smaller than or equal to 0.5.

If the basic test is not performed, in any case the influence of gas temperature ΔT is taken conventionally equal to 0.5 % in order to calculate the global influence as laid down in B.5.

B.5 Global influence

The global influence ΔI of above influence quantities or parameters is calculated with the following formula:

$$\Delta I = [(\Delta F)^2 + (\Delta P)^2 + (\Delta T)^2]^{1/2}$$

Where, ΔF , ΔP and ΔT signification is given above.

The largest individual error in absolute value recorded according to 10.2.6.1 is called E_n .

The largest individual error at metering conditions E_m is calculated with the following formula:

$$E_m = [(E_n)^2 + (\Delta I)^2]^{1/2}$$

This value shall be smaller than or equal to the maximum permissible error laid down in Table 2.

B.6 MPEs at initial verification

B.6.1 MPEs at the first stage of initial verification

Assuming that the influence tests are reproducible for the pattern the here above results are used to determine MPEs at the first stage of initial verification.

MPEs at the first stage of initial verification (MPE1), positive or negative, are calculated using the following formula :

$$(B1)^2 = (MPE1)^2 + (\Delta F)^2 + (\Delta P)^2 + (\Delta T)^2$$

Where:

- B1 is the value laid down first line of Table 2 for the appropriate accuracy class,
- ΔF , ΔP , ΔT are above values.

Note: MPE1s, are applicable to individual measurement results, and not to mean values of errors.

B.6.2 MPEs at the second stage of initial verification

MPEs at the second stage of initial verification, positive or negative, are the values laid down first line of Table 2 for the appropriate accuracy class (B1).

Note: B1 is applicable to individual measurement results, and not to mean values of errors.

B.7 Specific cases

B.7.1 Orifice plate meters

Tests laid down in B.2 to B.4 are not necessary for a metering module with an orifice plate meter when built, installed, operated and verified according to ISO 5167.

In this case the metering module is considered to meet the requirements for class A when it is installed in the best conditions foreseen in ISO 5167 and it is fitted with class A associated measuring instruments.

The metering module may also meet requirements for other classes when installed in appropriate other conditions specified in this standard and to be indicated in the type approval certificate.

B.7.2 Piston rotary meters

When the corresponding tests are not performed, ΔF is considered to be equal to 0.33%.

Tests for influence of pressure are not necessary. When these tests are not performed ΔP is considered to be equal to 0.5%.

Provisions in B.2 concerning pressure reducers are not applicable to piston rotary meters.

B.7.3 Approval of a single metering module (unit type approval)

When a metering module is designed, constructed and installed as a single module (unit type approval) tests in B.2.1 may be replaced by tests in actual site of use provided that test conditions are representative of all critical conditions likely to occur on site.

This does not prevent other tests in this annex to be performed and to apply provisions in B.5 and B.6.

Each test result shall fulfil MPEs at metering conditions laid down in table 2 in 6.2.1. The influence to be used for applying provisions in B.5 and B.6 is the largest difference between tests at nominal conditions and tests in each critical condition. When nominal conditions are unknown the results at nominal conditions are chosen as the mean values of tests in critical conditions.

ANNEX C

PRINCIPLES OF THE MODULAR APPROACH AND OF ERROR CALCULATION

(Mandatory as far as principles are concerned)
(Informative as far as examples are concerned)

C.1 Principles

C.1.1 The modular approach is based on the fact that specific maximum permissible errors are applicable to each of the following functions (see Table 2):

- measuring at metering conditions,
- converting at base conditions,
- converting in energy.

Moreover for metering, specific maximum permissible errors may be applied separately for:

- the meter (corrected if necessary),
- influences on the meter (see Annex B).

Starting from these modular maximum permissible errors, the global maximum permissible errors can be calculated for the complete system (see Table 1) using the square root of the sum of all the relevant square maximum permissible errors (see example in C.2).

The same approach may be used for approval of a conversion device.

C.1.2 When calculating the error of a measuring system or of a device the following rules apply, unless specific provisions are provided:

- 1 Where the effective errors of the components or modules are known, they are taken into consideration,
- 2 Where errors are not known (but errors fulfil maximum permissible errors for the relevant module or device), the maximum permissible errors for the components are considered, whether the corresponding parameters are measured or not. In this latter case, the documented provisions system shall ensure that the uncertainty of the non measured parameters is at least as good as the corresponding MPE (see examples in C.3).
- 3 In any case a module has to fulfil its own applicable MPEs.

Examples:

- for a class C measuring system, where the calorific value is not measured locally the documented provisions shall ensure a global uncertainty/error for energy conversion of at most 2 % ($k=2$);
- for a class C measuring system, where the pressure of the gas is not measured for the determination of the converted volume, it is possible to fulfil the requirement with a conversion device using only an associated measuring instrument for temperature which fulfils the requirement in Table 3 provided the documented provisions ensure a global uncertainty/error of at most 1 % for pressure ($k=2$);
- for a class B measuring system, where the compression factor of the gas is not measured for the determination of the converted volume, it is possible to fulfil the requirement with a conversion device using associated measuring instruments for temperature and pressure which fulfils the requirement in Table 3-1 provided the documented provisions ensure a global uncertainty/error of at most 0.3 % for the compression factor ($k=2$).

C.1.3 The modular approach leads to combine uncertainties and maximum permissible errors applicable to these elements in order to calculate errors of devices including these elements or of the measuring system.

For this purpose when an error or maximum permissible error has to be combined with standard uncertainties, the coverage factor which is used shall be conventionally equal to 2.

According to the same logic when a combined standard uncertainty is calculated the corresponding expected error shall be equal to twice this value. The conventional error so determined shall be smaller than or equal to the maximum permissible error (see example in C.3).

C.2 Example of MPE calculation (Class A measuring system)

Module	modular MPE (%)	square modular MPE	Measuring system converting at base conditions	measuring system converting in energy
Metering module	0.7	0.49	0.49	0.49
Conversion at base conditions	0.5	0.25	0.25	0.25
Determination of/Conversion in energy	0.6	0.36	---	0.36
Square MPE for measuring system	---	---	0.74	1.10
MPE for measuring system (%)	---	---	0.860 (rounded to 0,9)	1.049 (rounded to 1)

C.3 Examples of error calculations

C.3.1 First example: local CVDD

The purpose of this example is to evaluate the performance of a class A energy measuring system (MS) including the following:

- a class A metering module,
- a class A volume conversion device,
- an energy conversion device involving 2 local calorific value determining devices.

C.3.1.1 Error of the metering module (MM)

The MM is fitted with several branches. However the only available useful information is that the MM meets MPEs in all rated operating conditions.

The error that will be used for the calculation of the error of the MS is equal to the applicable MPE equal to 0.7 %.

$$E_{MC} = 0.7 \%$$

C.3.1.2 Error on volume conversion

The only available useful information is that the volume conversion device meets MPEs in all rated operating conditions.

The error that will be used for the calculation of the error of the MS is equal to the applicable MPE equal to 0.5 %.

$$E_{QC} = 0.5 \%$$

C.3.1.3 Error on CV determination

Error of the CVDDs

The only available useful information is that the CVDDs meet MPEs and all requirements in all rated operating conditions.

The error that will be used for the calculation of the error on the determination of CV is equal to the applicable MPE equal to 0.5 %. When only one CVDD is operating the corresponding uncertainty component is:

$$u_{CVDD} = 0.5/2 \%$$

$$u_{CVDD} = 0.25 \%$$

In addition, the errors of the CVDDs may be considered as independent one from another because the CVDDs are of two different types. When the two CVDDs are operating the mean value is considered. The corresponding uncertainty component is:

$$u_{CVDD} = 0.5/2 \sqrt{2} \%$$

$$u_{CVDD} = 0.177 \%$$

Uncertainty on time determination

For a class A MS this component is equal to zero

$$u_T = 0$$

Uncertainty on stability of CV

For each CVDD the CV is determined each 5 min. It is considered that the corresponding uncertainty component is provided by the greatest experimental standard deviation of the mean value ever met. The greatest experimental relative standard deviation (of individual results) ever met is 0,456 %. As 12 measurements an hour are performed to determine the representative CV, the relevant uncertainty component is:

$$u_c = 0.456/\sqrt{12} \%$$

$$u_c = 0.132 \%$$

Uncertainty on location

The CVDDs are local so the corresponding uncertainty component is nil

$$u_L = 0$$

Note: If the measuring results provided by these CVDDs are used for remote measuring systems a correction on CV for transit delay may be used with an associated uncertainty.

Other uncertainties

No other components are identified.

$$u_O = 0$$

Error on CV determination

In the case of only one CVDD operating, the error on CV determination is equal to :

$$E_{CV} = 2 \times \sqrt{0.25^2 + 0.132^2}$$

$$E_{CV} = 0.57 \%$$

In the case of two CVDDs operating, the error on CV determination is equal to :

$$E_{CV} = 2 \times \sqrt{0.177^2 + 0.132^2}$$

$$E_{CV} = 0.44 \%$$

C.3.1.4 Error of the measuring system

All the modules fulfil the applicable MPEs and the MS is acceptable.

In the case of 2 CVDDs, the error of the MS could be estimated smaller than or equal to:

$$E_{MS} = \sqrt{0.7^2 + 0.5^2 + 0.44^2} = 0.96 \%$$

C.3.2 Second example: reconstruction of CV and a posteriori demonstration

A network is supplied by two gas origins each at one inlet point. A CVDD is used at each inlet point. The network is divided in three zones:

Zone 1: in the vicinity of inlet point 1, the CV is considered to be the one measured at this inlet with a transit delay.

Zone 2: the gas delivered is a mixture of the gases of the 2 origins depending at each time of the consumption of all measuring systems of the network and of the configuration of the network. For each measuring system the gas company uses a software taking into consideration appropriate parameters for determining the local CV. This is the so called reconstruction procedure.

Zone 3: in the vicinity of inlet point 2, the CV is considered to be the one measured at this inlet with a transit delay.

C.3.2.1 Zones 1 and 3

See C.3.1, taking into consideration the note in the paragraph on uncertainty on location. The distinction of the zones 1 and 3 could be interesting in particular in order to consider the case of Class A measuring systems without local CVDDs.

C.3.2.2 Zone 2

The purpose of this example is to evaluate the performance of a class B energy measuring system including the following:

- a class B metering module,
- a class B volume conversion device,
- an energy conversion device using reconstructed (calculated) values of CV, associated with documented provisions involving in particular transportable CVDDs (possibly in addition fixed ones) on the network here after called checking CVDDs.

C.3.2.2.1 Error of the metering module (MM)

The only available useful information is that the MM meets MPEs in all rated operating conditions.

C.3.2.2.2 Error on volume conversion

The only available useful information is that the volume conversion device meets MPEs in all rated operating conditions.

C.3.2.2.3 Error on CV determination

It could be possible to imagine calculating the corresponding uncertainty component according to a sophisticated method implemented according to the GUM. However it is decided to let the gas supply company to announce the performance of the software and to compare this announced performance to the experimental performance.

In practice the gas company announces that according to the implemented software and the documented provisions, no true value of CVs on site should deviate from the calculated value determined using the software by more than a stated announced value (AV). However an allowance may be made for a slight mismatching for these announcement, for example by accident one day in a month, corresponding to a matching level of $29/30 = 0.966\%$.

The Authority controls this statement in the following way:

- 1 At the initial demonstration, class A checking CVDDs are used and placed temporarily (in addition possibly of fixed ones) to some appropriate locations. It is checked that all calculated CVs (using the software) do not deviate from CVs measured locally by more than the stated value.
- 2 This assumption is continuously checked, from locations to other locations, using some class A checking CVDDs.

Error of the CVDDs

The CVDDs taken into consideration for the calculation of the error are the checking CVDDs. For the zone 2, the CVDDs used at the inlet points are part of the documented provisions (as the reconstruction software) but do not have to be considered for the determination of errors on CV. Nevertheless the CVDDs at the inlet points need to be subject to the legal control because the result of the calorific value is based on them.

The only available useful information is that the checking CVDDs meet MPEs and all requirements in all rated operating conditions.

The error that will be used for the calculation of the error on the determination of CV is equal to the applicable MPE that is 0.5% . The corresponding uncertainty component is :

$$\begin{aligned}u_{\text{CVDD}} &= 0.5/2 \text{ \%} \\ &= 0.25 \text{ \%}\end{aligned}$$

Uncertainty on time determination

This component is equal to zero:

$$u_T = 0$$

Uncertainty on stability of CV

The stability to be considered may be the stability of calculated CVs during the period of determination of the representative CV. However it could be decided to consider the stability observed using the values obtained from checking CVDDs.

It is considered that the corresponding uncertainty component is provided by the typical experimental standard deviation of the relevant mean values. For this example this typical value is:

$$u_c = 0,227 \text{ \%}$$

Uncertainty on location

Taking into consideration the demonstration here above referred, it is considered, according to the convention, that the uncertainty on location component is equal to the announced above value AV divided by 2.

$$u_L = AV/2 \%$$

The announced value is 1 % and then:

$$u_L = 0.5 \%$$

Note: The demonstration could have lead to the conclusion that the zone 2 should have to be split in two zones: one in class B and one in class C for CV determination.

Other uncertainties

No other components are identified, or more exactly, if any, are considered included in u_L .

$$u_O = 0$$

Error on CV determination

The error on CV determination is equal to:

$$E_{CV} = 2 \times \sqrt{0.25^2 + 0.227^2 + 0.5^2}$$
$$E_{CV} = 1.21 \%$$

This value is in conformity with the corresponding line in Table 2.

C.3.2.2.4 Error of the measuring system

As each module of the metering system fulfils the applicable MPEs, the error of the energy metering system is acceptable.

C.3.3 Third example: daily average CV assignment

Consider an area in a network supplied from one inlet point. A class A CVDD is used at the inlet point. The metering systems considered in this area and in this example are class B ones. The MPE for the representative CV determination in this area is then 1.25 %.

Assume that this area is flushed at least within one day, i.e. that the gas entering this area leaves it at least in less than one day, either by being consumed or by flowing across to downstream areas. This assumption can be demonstrated by taking account the hydraulic volume of the area and the worse operating conditions, T_{min} , P_{max} .

In this case, only two gas qualities may coexist in this area at any time during one day j, the possible residue of the gas G_{j-1} which entered it on day j-1, that may not have been consumed or have left yet, and the arriving gas G_j during the day j.

Assume that the daily average CV on day j is CV_j , respectively CV_{j-1} on day j-1, and $D_{cv} = |CV_j - CV_{j-1}|$.

Error of the CVDD

The uncertainty component due to the CVDD that will be used for the calculation of the error on the determination of CV is equal to the applicable MPE class A, 0.5 %:

$$u_{CVDD} = 0.5/2 \% = 0.25 \%$$

Uncertainty on time determination

On this day, $u_L = 0$

Uncertainty on location

Due to possible intricate connections of the pipes into this area, it is not possible to determine the exact location of each gas quality.

The gas in this area is assigned during this day an average $CV = (CV_{j-1} + CV_j)/2$, with an uncertainty $(CV_j - CV_{j-1})/\sqrt{12} = D_{cv} / \sqrt{12}$ (rectangular distribution).

$$u_L^2 = D_{cv}^2 / 12$$

Uncertainty on stability of CV

The CV is determined in the CVDD class A each 5 min, leading to $12 \times 24 = 288$ analyses a day.

Assume that the maximal experimental standard deviation is 0.5%. The relevant uncertainty component of the mean value is then:

$$u_c = 0.5 / \sqrt{288} \% = 0.03 \%$$

Due to the expected range of CV for the transmitted pipelines gases and to the large number of analyses, this leads quite always to a small figure in practice.

Other uncertainties

No other components are identified.

$$u_o = 0$$

Error on daily representative CV determination

$$E_{CV} = 2 \times \sqrt{0.25^2 + D_{cv}^2 / 12 + 0.03^2}$$

Meeting the requirement in practice:

For $D_{cv} = 1.98\%$, $E_{CV} = 1.25\%$

In this case, the requirement is met ($MPE < 1.25\%$) as long as the area is flushed within one day, the experimental standard deviation of the daily CV is less than 0.5 % and the variation from one day to the next one of the daily average CV, D_{cv} , is less or equal than $< 2 \%$.

In practice, as long as the gas company provides information, according to documented provisions, that these three initial assumptions have been met, this gas company is entitled to use this procedure on this area during this period of time for this gas.

According to the general convention used in this document introducing a coverage factor of 2 (equivalent to a 95 % confidence level assuming a normal distribution), an allowance may be made for a slight mismatching for these criteria, for example by accident one day in a month, corresponding to a matching level of $29/30 = 0.966 \%$.

C.4 Other examples of management of calorific value and energy


C.4.1 First example

Basic definitions:

«Charging area» is an area for which the gas transporter uses a single calorific value for the calculation of energy conveyed to premises or to pipelines operated by other PGTs.

«Input points» are places at which gas passes from the high pressure national transmission system into the distribution system of the charging area.

Example is a charging area being supplied through 4 input points at which gases of different calorific values enter the distribution system.

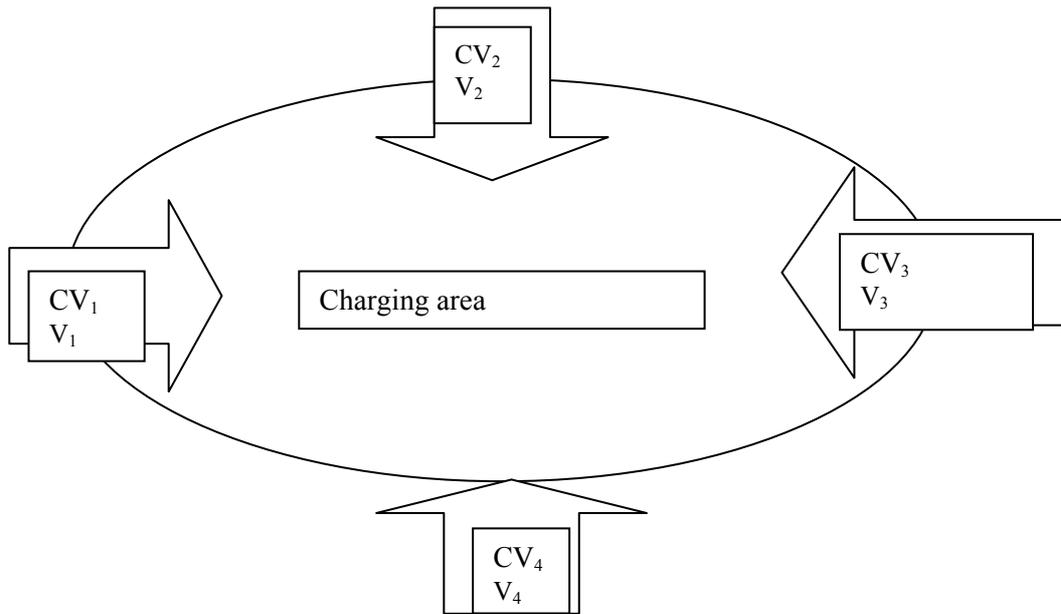

A. FIXED ASSIGNMENT BASED ON LOWEST SOURCE CV

The regulation requires that on a daily basis the lowest calorific value of any gas entering the charging area is used in the calculation of the quantity of energy conveyed to premises in the charging area.

In the example the gas passing each of the input points will have its calorific value determined either at the input point or at a point on the high pressure pipeline feeding the point. The lowest calorific value of CV₁₋₄ determined for these input points is assigned to all the interfaces within the charging area (on a daily basis).

There is measurement of CV but volume measurement is not required.

B. VARIABLE ASSIGNMENT BASED ON FLOW WEIGHTED AVERAGE CV

The regulation requires the calculation of a flow weighted average calorific value (FWACV) for each day from:

$$FWACV = E/V$$

Where:

E = the sum of all the relevant energy inputs at the input points; and

V = the sum of all the relevant volume inputs at the input points.

For the example:

$$FWACV = (CV_1*V_1 + CV_2*V_2 + CV_3*V_3 + CV_4*V_4)/(V_1+V_2+V_3+V_4)$$

This requires each input point to have volume measurement and calorific values to be determined, either in situ or by attribution from elsewhere.

The calorific values are the daily average for the input point and the volumes are the total for the day.

C.4.2 Second example

Volume meters, conversion devices and calorific value determining devices (CVDDs) together with their relevant additional devices are subject to type approval, initial and final verification and shall be used under approved installation conditions only.

Gas has to be accounted for in terms of energy E which is calculated from the volume of the gas delivered V and its representative calorific value \overline{H} .

The calorific values of differing gases entering a charging area shall be determined at representative sites by approved methods.

The representative calorific value for each site x ($\overline{H_x}$) can be calculated as the arithmetic or volume weighted mean value. The representative volume weighted monthly mean calorific value $\overline{H_x(m)}$ (averaged over d days of the month) is calculated from daily volumes and daily calorific values $H_x(d)$, the latter being arithmetically averaged over all n individual calorific values $H_{x,n}$:

$$H_x(d) = \frac{\sum_1^n H_{x,n}}{n} \quad (1)$$

$$\overline{H_x(m)} = \frac{\sum_1^d H_x(d) V(d)}{\sum_1^d V(d)} \quad (2)$$

The representative arithmetically weighted monthly mean calorific value $H'_x(m)$ is calculated from daily calorific values $H_x(d)$:

$$H'_x(m) = \frac{\sum_1^d H_x(d)}{d} \quad (2')$$

The representative yearly mean calorific value $\overline{H_x(y)}$ is calculated from monthly volumes $V(m)$ and monthly calorific values $\overline{H_x(m)}$ or $H'_x(m)$:

$$\overline{H_x(y)} = \frac{\sum_{m=1}^{m=12} \overline{H_x(m)} V(m)}{\sum_1^{m=12} V(m)} \quad (3)$$

In charging areas where j gases of different calorific values are fed into the area at the same input point and mixed, the representative calorific value \bar{H} is determined by measuring the calorific value of the mixture or by calculated the mean calorific value as the volume weighted mean value from the volumes and calorific values of the j individual gas streams:

$$\bar{H} = \overline{H_x} \quad (4)$$

or

$$\bar{H} = \frac{\sum_1^j H_j V_j}{\sum_1^j V_j} \quad (4')$$

In charging areas where gases of different calorific values are fed into the area at locally different input points, the calorific values are determined for each input point (H_x). If the calorific values at the different input points do not differ by more than the maximum permissible error in use from the volume weighted mean value for this charging area, this volume weighted mean value can be used. Otherwise, a more or less sophisticated state reconstruction system (which itself is subject to approval) shall be used.

$$\left(\overline{H_x} - \bar{H} \right)_{\text{for all } x} \leq \text{mpe}_{\text{in service}} \Rightarrow \bar{H} = \overline{H_x} \quad (5)$$

$$\left(\overline{H_x} - \bar{H} \right)_{\text{for any } x} > \text{mpe}_{\text{in service}} \Rightarrow \text{State reconstruction} \quad (5')$$

ANNEX D

GENERAL CONSIDERATIONS ON GAS MEASURING SYSTEMS

(Informative)

D.1 Constituting of an energy measuring system

Hereafter are the different possibilities of making a legal measuring system starting from a volume indication converted at base conditions. It has to be adapted in case of a converted mass or a direct mass.

In principal communications concerning the metering module are secured.


For conversion functions either any communication shall be secured or the communications between the VCD and the ECD and between the CVDD and the ECD shall be such that a documented provisions system ensures that appropriate data are used as described hereafter. The principal of documented provisions system is also applicable when the pressure is not measured at the metering point.

ABBREVIATIONS AND SYMBOLS

M	Meter
VMC	Volume at metering conditions
VCD	Volume conversion device
VBC	Volume at base conditions
CVDD	Calorific value determining device
ECD	Energy conversion device
E	Energy
SL —	Secured communication
NS ---	Non secured communication
ME →	Manually entered data

FIRST CASE

Secured communications and a CVDD close to the meter

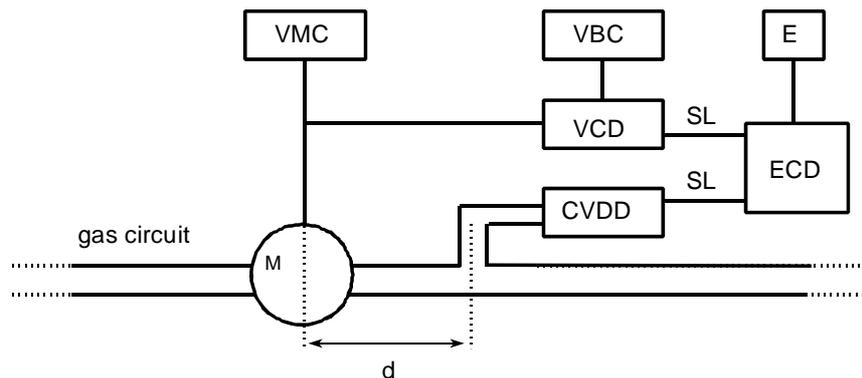

This system is a classical legal measuring instrument.


NOTE: The distance d is so that the characteristics of the metered gas are the same than those of the gas which is analysed in the CVDD.

SECOND CASE

Secured communications and a remote CVDD

This is the case for instance where only one CVDD is used to determine the calorific value for a region.

NOTE: The distance between the ECD and the remaining of the measuring system is not relevant neither the number of ECD is relevant.

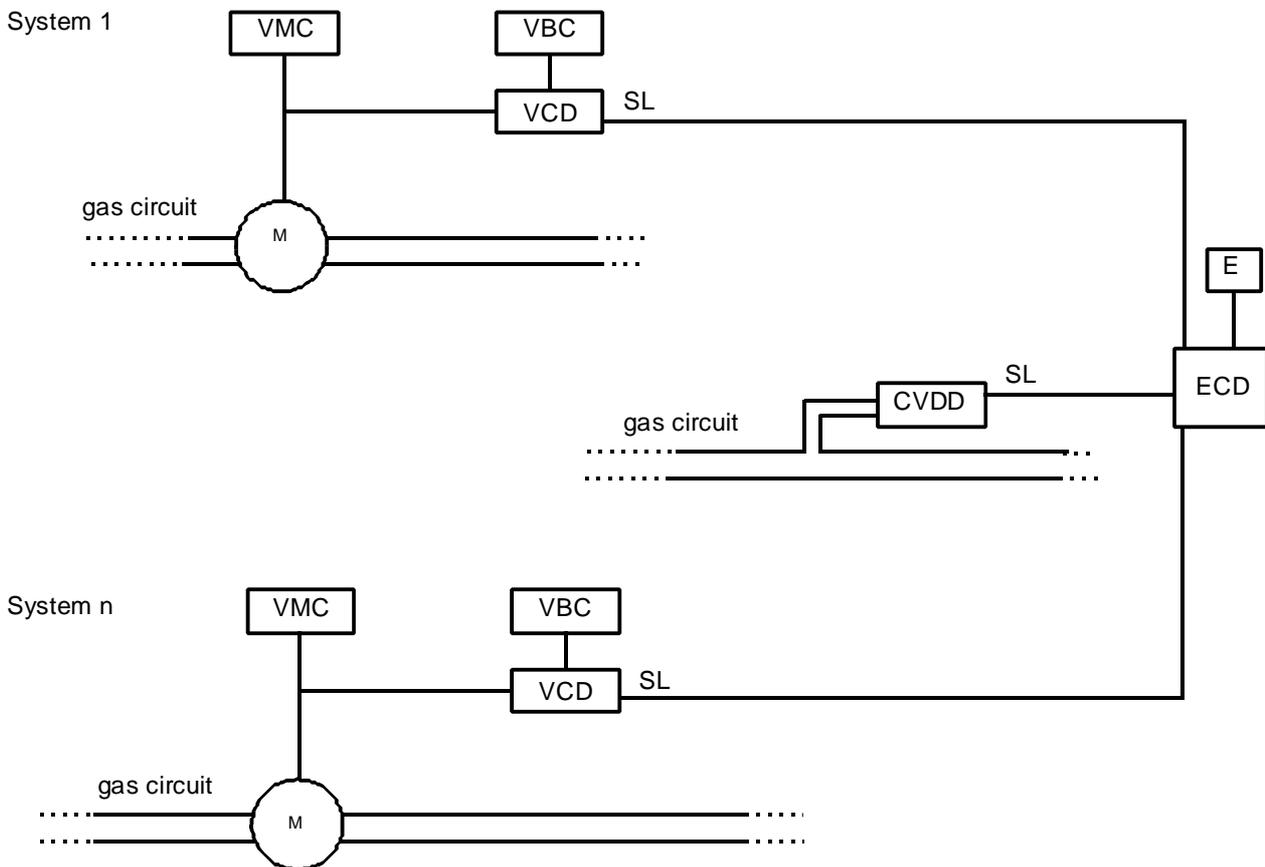

A legal measuring instrument is made of:

- a measuring system itself and
- documented provisions ensuring that data used for computing the energy are representative of the calorific value of the gas passing in each meter.


NOTE: Documented provisions are let to national authorities.

THIRD CASE


Non secured communications and/or manually entered data

NOTE: This is the relevant case where at least one communication is not secured.


. First example

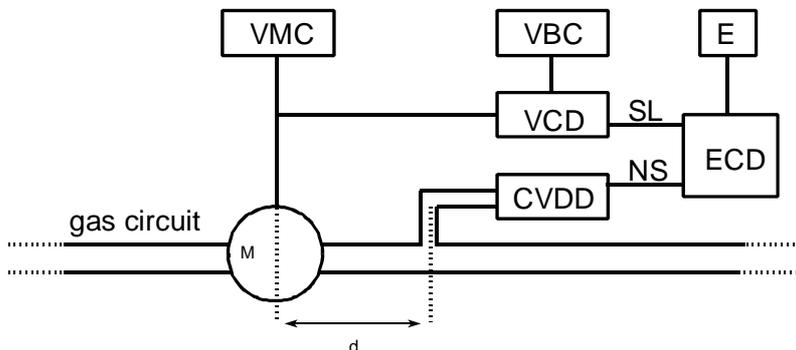

. Second example

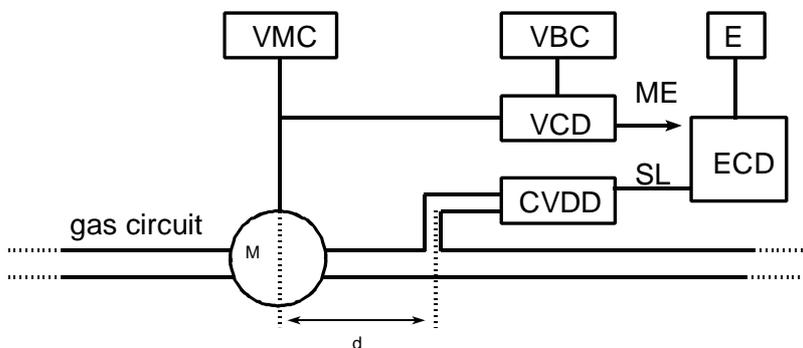

. Third example

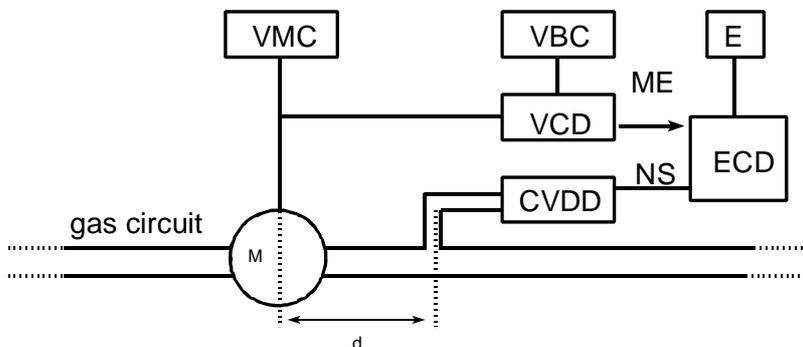

A legal measuring instrument is made of:

- a measuring system itself and,
- documented provisions ensuring that data used for computing the energy are correct that is they are those measured by the VCD and the CVDD and,
- moreover in case of a remote CVDD, documented provisions ensuring that data used for computing the energy are representative of the calorific value of the gas passing in each meter.

NOTE: Documented provisions are let to national authorities.

D.2 Flow measurement technologies

Meters fitted in measuring systems in the scope of this recommendation may be of any technology with the exception of diaphragm meters, although the complete modular approach is only possible for technologies considered in Annex B.

D.2.1 Orifice plate, venturi, nozzle gas meters

See ISO 5167.

D.2.2 Turbine meter

The turbine meter is a meter in which the gas flow drives a wheel the number of rotations of which corresponds to a measure proportional to the transmitted gas volume. *see OIML R 32 (under revision)*.

D.2.3 Rotary piston meter

The rotary piston meter is a meter wherein the internal walls limiting measuring chambers are put into revolution under the action of gas; the number of revolutions of those walls corresponds to a measure for the transmitted gas volume. *see OIML R 32 (under revision)*.

D.2.4 Ultrasonic meter

Meter determining the transmitted quantity of gas by integration of the gas flow, which is defined by the measure of the transit time needed by an ultrasonic wave (this time depends on the sound velocity in gas and the gas velocity) or by the Doppler frequency shift of an ultrasonic wave.

D.2.5 Vortex meter

The vortex meter operates by sensing the vortices shed from alternative sides of a bluff body located in the flowing fluid. The frequency of vortex shedding is proportional to the Strouhal number of the fluid.

D.2.6 Coriolis mass flow instrument

A measuring instrument that determines the mass of a quantity of flowing gas using the phenomenon of Coriolis strain without the use of any auxiliary device or data on the physical properties of the gas.

D.2.7 Other measurement principles

Any other measurement principle giving an output signal in function of the volume, mass or energy having crossed the meter.

D.3 Design of measuring systems

The design of a measuring system shall be based on the minimum and maximum values relating to :

- the volume, mass or energy flowrate;
- the design pressure and the operating pressure;
- the gas temperature and the ambient temperature and;
- the gas composition.

D.3.1 Minimal design criteria

According to here above criteria, technical and economical considerations the authorities may decide the constitution of measuring systems. The following table gives guidelines for this.

Table 5

Minimal design criteria for the constitution of measuring systems

Design Q_{max} at base conditions. m^3/h	Less than or equal to 1000	More than 1000	More than 10000	More than 100000
Meter's curve error correction		*	*	*
Provision for local proving system			*	*
Temperature conversion	*	*	*	*
Pressure conversion		*	*	*
Z conversion		*	*	*
Local CV ¹ and gas quality determination			*(or see row below)	*
Remote CV determination (sampling or computation)	*	*	*	
Registration of flow quantities per time intervals			*	*
Alternative for here-above conversions : density measurement			*	*
Accuracy class	C	B	A or B	A

* device or function advisable

¹ CV = calorific value

D.3.2 Measurement of the characteristics of the gas

In order to achieve the best accuracy, the measurements of the characteristics of the gas (pressure, temperature, density) should be made on every measurement branch so that:

- it influences neither the flow nor the measurement of the transmitted quantity; and,
- it ensures the values of the measured quantities corresponding to the conditions at the measuring point of the gas flow.

One associated measuring instrument is sufficient for the whole measuring system to measure parameters (density, calorific value, etc...) which are common to all the branches under normal operating conditions and to measure the gas composition, provided the maximum influence specified in 7.3.4.3 is respected.

For the density measurement, the use of two measurement instruments is recommended to detect an error in one of them.

D.3.3 Optional equipment

The measuring system may transmit metrological information to other equipments such as totalizers, recorders or telemetry equipment. The legal status (subject to control or not) of transmitted information is subject to considerations of the authorities.

The variables measured at the metering station may be displayed, recorded or stored as analogical or digital data and may be recorded and stored by appropriate devices as a function of time and volume.

D.3.4 Ambient temperature

Some types of equipment, like calculators and other electronic devices, can only operate correctly within a limited temperature range (the rated operating conditions are specified in 7.1.2). Where controlled ambient temperature is required to maintain the accuracy of this type of equipment, the operator should verify that the ambient temperature is properly monitored and maintained.

D.4 Provisions concerning the inlet flow profile

For all types of meters technologies affected by the inlet flow it is essential to have fully developed gas flow profiles, pertinent to the fluid and flow conditions.

D.4.1 Conditions

Vortex conditions and velocity profiles may be accepted if the effect is smaller than specified by the meter's manufacturer or if it is within the appropriate product standard.

D.4.2 Piping Requirements

In order to reach acceptable flow profile conditions, the general measures below will be taken. These measures can be connected with the specific remarks relating to different types of meters and stated in D.2 taking into account that all meters do not have the same sensitivity to flow profile disturbances. See Subclause D.4.4 for the assessment of other methods.

- a) The necessary upstream and downstream piping as well as the gas meter should all have the same nominal bore.
- b) Any valve at the inlet of the straight pipework upstream of the meter should normally be a full bore valve having the same diameter as the pipe. This valve should be fully open when the flow meter is making measurements
- c) Additional precautions, regarding flow profile, should be taken if a flow regulating valve or a pressure regulator is located upstream of the meter.
- d) The use of pipe fittings or equipment generating markedly asymmetric or swirled flow profiles should be avoided over a sufficient length, depending on the meter type, upstream of the gas meter. For example single or double elbows, reducers, etc.
- e) Piping configurations that generate swirl. (For example bends that are not coplanar should be avoided over sufficient length - depending on the meter type - upstream of the gas meter , as swirling can persist over very long straight pipes lengths i.e. more than 100 D depending on the Reynolds number, pipe roughness, etc...).

D.4.3 Flow conditioners

If the conditions required upstream of a given meter to maintain its accuracy cannot be reached (for example: because insufficient space or because the measuring system is combined with a pressure regulating station), a flow conditioner should be required. The upstream distance in order to enable the flow profile to reach the quality required as far as the velocity profile and the turbulence distribution are concerned should be specified at the time of type approval.

As the flow conditioner influences the meter's accuracy, the meter and the flow conditioner should be calibrated as a single unit . The relative position of the meter and of the flow conditioner shall be secured.

D.4.4 Assessment of an acceptable flow profile

When the piping and/or the flow conditioner do not provide the quality required for the upstream flow profile, there are two possibilities:

- a) either measure the flow profile and check whether the pipe flow profile at the meter 's inlet is satisfactory according to the above described characteristics;

b) or, calibrate the gas meter including its upstream piping and the flow conditioner if any, all being transported without disassembling after calibration or with special precautions to make sure that the pipework and meter are installed in the same position as during the calibration. (See preceding paragraph)

Note: This provision must be considered as an advice, for instance for gas industry, but must not be considered as contradicting Annex B.

D.4.5 Unstable flow

In some applications the gas flow may be pulsating, vibrating, intermittent or alternating. The resulting effects on the metering indication are dependent on the type of the meter, its design, the gas density and the working regime of the whole measuring system. It can lead to significant systematic measuring errors. The unstable flow effects should be taken into account at the design phase of the measuring system as well as at the time of selecting the meter.

D.4.5.1 Pulsation effects

Pulsation effects have to be checked when the meter is installed upstream or downstream of:

- piston-type compressors,
- rotary piston gas meters,
- dead end pipes generating resonances or
- unstable pressure regulators.

The influence of pulsations can be reduced by increasing the distance between the meter and the pulsation source or by using suitable pulsation dampers.

D.4.5.2 Vibrations

Vibrations can arise when the mechanical natural frequency of the pipe system is equal or very close to the excitation frequency caused by elements as mentioned above (D.4.5.1), by the gas meters themselves or by flow induced pulsations. To prevent or minimize vibration effects on the gas meter appropriate calculations for the whole measuring system should be done, preferably at design stage. In particular, ultrasonic gas meters should not be installed where vibration frequencies (or their harmonics) might be close to the frequencies used by ultrasonic transducers.

D.4.5.3 Intermittent flow

An intermittent flow is generated if the flowrate repetitively changes between a nearly constant flowrate to no flow. For gas meters with moving/rotating elements, in particular turbine gas meters, measuring errors of up to 20 % or more can be induced by “after-run” measurement. Furthermore, attention has to be paid to choose the optimum gas meter size. Oversized gas meters enlarge the after-run error. Intermittent flow errors can be avoided by selecting the appropriate type of meter and avoiding oversized flow transducers.

D.4.5.4 Alternating regime

For alternating working regimes of a gas meter the statements about intermittent flows should be applied analogously.

D.4.6 Specifications relating to rotary piston gas meters

D.4.6.1 Upstream velocity profile

At low pressure, rotary displacement gas meters are generally not sensitive to the configuration of the piping. For higher pressures, for example above 700 kPa, it is necessary to place upstream and downstream two straight sections of pipe with the same nominal diameter as the meter's flanges.

D.4.6.2 Pressure surges generated by the meter

Small volume variations during the operating cycle of the meter are inherent in the operation of some types of rotary displacement meters. These variations generate small pressure surges both upstream and downstream of the meter. Parallel or series configurations shall require adequate piping in order to eliminate the risk of interferences.

ANNEX E

CALIBRATION GASES

(Mandatory/informative)

E.1 CALIBRATION GASES FOR INSTRUMENTS FOR THE DETERMINATION OF THE CALORIFIC VALUE

Calibration gases certified for calorific value and composition, where applicable, are used during type approval, initial verification, subsequent verification, and normal operation of calorific value measuring instruments, when authorised.

The general requirements concern stability, preparation, certification and use, the specific (technical) requirements describe the fields of application and the properties (composition, certified values, purity, uncertainty).

According to the application the calibration gases imply different specific requirements.

E.1.1	GENERAL REQUIREMENTS	Possible method for fulfilling the requirement/Comments
E.1.1.1	Reactivity of gases	
	The components of the calibration gas shall not react with each other.	Only saturated hydrocarbons, permanent gases and carbon dioxide shall be used.
E.1.1.2	Reactivity with materials	
	The gas components shall not react with or be influenced by materials used for the cylinder, valves, tubes, seals etc. Adsorption effects shall be avoided or minimized to a negligible extent. Diffusion through sealings shall not occur.	cf. ISO 10 715 (1997): Natural gas - Sampling guidelines, Ch. 6 - 7
E.1.1.3	Condensation	
	During use, transport and storage no change of the quantitative and qualitative composition shall occur. During preparation, transport and storage, the temperature of the bottle shall not be reached or fall below the dew temperature, including a safety margin. During use, the temperature of the calibration gas cylinder shall exceed the dew temperature, including a safety margin. No retrograde condensation shall occur. During expansion through valves, tubes or pressure regulators, the cooling due to the JOULE/THOMSON effect shall not cause condensation	The dew temperature of the gas shall be known and the gas maintained above that temperature. If necessary, a heating device shall be provided with the cylinder. If necessary, the respective devices shall be equipped with a heater of sufficient power to heat the gas far enough above ambient temperature, so that even with adiabatic expansion the temperature exceeds the dew temperature plus its safety margin.

	<p>The determination of the dew temperature and maximum pressures during and after the filling process has to be performed by :</p> <p>a) An appropriate measurement method (cf. ISO NP 15 972-2). Natural gas - Measurement of properties - Single component and condensation properties - Part 2: Hydrocarbon dew point).</p> <p>b) calculation with an appropriate computer program for phase properties.</p> <p>c) estimation on the bases of calculated compression factors (cf. ISO 12 213: Natural gas - Calculation of compression factor).</p> <p>d) estimation on the basis of vapour pressures.</p> <p>These methods are given in the preferred order.</p>
E.1.1.4 Life time and final pressure	
<p>The maximum lifetime of the calibration gases shall be specified.</p> <p>The final pressure in a calibration gas cylinder shall not fall below ambient pressure plus a safety margin sufficient to prevent diffusion of air into the cylinder.</p>	It should not exceed 5 years.
E.1.1.5 Handling	
The handling of calibration gases shall be done according to the accepted good laboratory practice for pure gases by qualified personnel only.	
E.1.1.6 Preparation, certification and traceability	
The preparation should preferably be done gravimetrically.	cf. ISO 6142: Natural gas - Preparation of calibration gas mixtures - Gravimetric methods.
The final composition of the gas shall be checked by gas chromatography or any other appropriate method.	cf. ISO 6143: Gas analysis - Checking of calibration gas mixtures by a comparison method.
All calibration gases shall be traceable to national or international standards. The certification to the required uncertainties on calorific value or gas composition shall be performed by an authorised institution.	The calorific value can be calculated from the known composition, where the uncertainty of the concentration determinations is sufficient below the MPE, or determined directly using a measuring instrument.

E.1.1.7 Certificate	
Each cylinder shall be accompanied by a certificate and detailed instructions for the shipper.	The amount of information of this certificate is the mandatory and optional data as in ISO/DIS 6141 (06/97). An extract of this information has to be affixed to the cylinder. Especially, the minimum transport temperature shall be given
E.1.1.8 Units	
The unit of composition to be used is mole or mass fraction; all other properties shall be given in the respective SI unit.	

E.1.2 SPECIFIC REQUIREMENTS FOR CALIBRATION GASES FOR INSTRUMENTS FOR THE DETERMINATION OF THE CALORIFIC VALUE

E.1.2.1 Gases for type approval

Calibration gases for type approval are chosen by the respective institution according to the property under investigation.

E.1.2.2 Gases for initial and subsequent verification

Where appropriate, after each verification, the cylinders shall be sealed.

E.1.2.3 Gases for continuous adjustments and routine checks

When authorized and according to the manufacturer's recommendation and the type approval results, none, one or more calibration gases of given certified (where applicable) composition and certified calorific value shall be used during the verification validity period for continuous calibration and adjustment (if applicable) of the instrument.

When only one calibration gas is used, the calibration gas should have similar calorific values as the long-term mean value for the installation site. When two or more calibration gases are used, the calibration gases should be equally spaced in order to cover the long-term CV-range for the installation site.

The calibration gas cylinders shall be permanently connected to the instrument, the tubing shall be easily visible without additional connections. A technique preventing mixing of calibration gas and pipeline gas shall be used. All connections shall be sealed during verification.

The exchange of the calibration gas requires a new verification.

E.1.2.4 Gases for maintenance work

If regular maintenance work during the verification validity period is necessary to keep the instrument in the properly working condition, the calibration gases to be used are chosen during the type approval process according to the manufacturer's recommendation.

This maintenance work and the calibration shall be possible without breaking seals.

E.1.3 COMPOSITION AND PHYSICAL PROPERTIES

The calibration gas shall contain all relevant components for the intended purpose, where necessary. Its physical and chemical properties (e. g. calorific value, density, WOBBE number) shall be suitable for the identification of the influencing factors by calibration and their elimination by adjustment.

E.1.3.1 Recommended mixtures

The following table summarises the recommended compositions of the different categories of the calibration gas and the properties to be certified. Deviations from the recommendations may be specified in the type approval certificate.

Physical principle	direct measuring	Indirect measuring	correlation techniques	calculation from composition
purpose				
calibration	CH ₄ H ₂ CH ₄ /N ₂ CH ₄ /C ₂ H ₆ CH ₄ /N ₂ /H ₂ certified for CV (H ₂ ; CH ₄ : purity)	according to physical principle as given by the type approval certificate certified for CV and the respective physical property		6 or more components* certified for composition and CV
verification	2 or 3 component mixtures as above certified for CV	6 or more component mixtures* certified for CV		
type approval	according to approval body			
maintenance	according to manufacturer's recommendation as specified in the type approval			

* CH₄, C₂H₆, C₃H₈, n-C₄H₁₀, N₂, CO₂

When preparing the mixtures, the relative deviation of the concentration of each component with respect to the nominal values given in the type approval in the final mixture shall be less than 5% and the deviation of the calorific value less than 1%.

E.1.3.2 Uncertainty of the certified values

For all calibration gases the uncertainty of the certified calorific value, as determined in ISO 6976 (1995) § 9 Accuracy: Natural gas - Calculation of calorific values, density, relative density and Wobbe index from composition, shall be less than 1/3 of the maximum permissible error, as far as feasible.

Examples of uncertainties for calibration gases certified for composition:

- ethane, propane, 2-methylpropane, n-butane, nitrogen: 1% relative
- all other components: 2 % relative
- methane: 0.2 % relative (if determined directly)

Notes:

- 1 If the composition of methane is not directly determined, this composition is the difference between 100 % and the sum of contents of other components.

- 2 Some National Authorities are used to compare the difference between the directly measured calorific value (using a well known CVDD) and the calorific value calculated from the measured composition. In this case results shall be consistent taking into account uncertainties.

E.1.3.3 Values used for calculation

The calculation of the properties of the gas shall be done according to ISO 6976 (1995): Natural gas - Calculation of calorific values, density, relative density and Wobbe index from composition.

Purity

The recommended purity of the gases used for the mixtures and as pure gases is:

- nitrogen, carbon dioxide, hydrogen: 99.999%
- methane: 99.995%
- ethane, propane, n-butane: 99.95%
- all other components: 99%

Lower purity gases are allowed subject to the impurities being certified and their concentrations taken into account in calculating the mixture composition and calorific value.

The determination of the purity shall be performed by an authorised institution.

Examples for mixtures

a) Calibration gases for calorimeters

component										
Nitrogen	N_2					7.00	8.70	11.70	17.5	17.00
Hydrogen	H_2		99.9990							49.00
Methane	CH_4	99.995		87.70	93.50	93.00	91.30	88.30	82.50	34.00
Ethane	C_2H_6			12.30	6.50					
Calorific value	MJ/m³	39.831	12.752	43.545	41.793	37.036	36.358	35.160	32.846	19.769
Standard density	kg/m³	0.7175	0.0899	0.7952	0.7585	0.7548	0.7639	0.7799	0.8108	0.5001

b) Calibration gases for gas chromatographs

component										
Helium	He									0.50
Oxygen	O_2							0.50		0.50
Nitrogen	N_2	0.40	14.40	12.00	10.30	1.00	4.00	4.00	4.00	5.00
Carbondioxide	CO_2	1.80	1.00	4.50	1.00	0.9	1.50	1.50	1.50	1.00
Carbonmonoxide	CO									0.50
Hydrogen	H_2									1.00
Methane	CH_4	84.00	81.00	82.00	83.00	96.40	83.85	88.45	88.90	86.44
Ethene	C_2H_4									0.50
Ethane	C_2H_6	9.40	3.00	0.75	4.00	1.00	8.20	4.00	4.00	2.50
Propene	C_3H_6									0.50
Propane	C_3H_8	3.40	0.50	0.30	1.25	0.25	2.00	1.00	1.00	1.00
n-Butane	C_4H_{10}	1.00	0.10	0.20	0.20	0.20	0.20	0.20	0.20	0.20
2-Methylpropane (iso-Butane)	C_4H_{10}			0.20	0.20	0.20	0.20	0.20	0.20	0.20
n-Pentane	C_5H_{12}							0.05	0.05	0.05
2-Methylbutane (iso-Pentane)	C_5H_{12}			0.05	0.05	0.05	0.05	0.05	0.05	0.05
2,2-Dimethylpropane (Neopentane)	C_5H_{12}								0.05	
n-Hexane	C_6H_{14}							0.05	0.05	0.06
Calorific value	MJ/m³	44.729	34.977	37.074	37.691	39.942	41.727	39.794	40.053	38.926
Standard density	kg/m³	0.8635	0.8339	0.8552	0.8348	0.7524	0.8435	0.8107	0.8084	0.8028

ANNEX F

MINIMUM TEST QUANTITIES FOR MEASURING SYSTEMS AND DEVICES

(Informative)

Provided it can be assumed that the largest uncertainty component is due to the rounding of the digital scale intervals, the following may be considered.

In case of a digital scale interval s and determination of errors of a meter it can be demonstrated that the distribution law is triangular and that the standard uncertainty u_s is:

$$u_s = \frac{s}{\sqrt{6}}$$

For this, it has to be considered that a single reading provides a rectangular distribution and that the reading of a metered quantity is made by difference of 2 consecutive values, which results into a triangular distribution.

With a coverage factor equal to 2, the expanded corresponding uncertainty U is:

$$U = 2 u_s$$

The requirement on uncertainty at type approval comparing to the tolerance T is:

$$U \leq \frac{T}{3}$$

That is :

$$s \times \sqrt{6} \leq T$$

1) Case of determining the error a complete measuring system with MPE = ± 1.5 % (example)

$$T = \text{MPE} = 1.5 \times 10^{-2} \times Q$$

The quantity Q is:

$$Q = n \times s$$

Where n is the number of scale intervals that is what we are looking for in fact. This leads to:

$$s \times \sqrt{6} \leq 0.015 \times n \times s$$

That is:

$$n \geq \frac{100\sqrt{6}}{1.5} = 163.3$$

Rounded to

$$n \geq 164$$

2) Case of determining the error of a metering module with MPE = ± 1 % (possible example at initial verification ; see B.6)

$$n \geq 163.3 \times 1.5/1 \text{ (ratio of MPE)}$$

$$n \geq 245$$

3) Case of determining the repeatability of a meter with a tolerance = ± 0.3 % (example)

$$n \geq 163.3 \times 1.5/0,3$$

$$n \geq 817$$

4) Case of determining the error of a class A calculator

$$T = 5 \times 10^{-4} \times n \times s$$

$$n \geq 163.3 \times 1.5 \times 10^{-2} / 5 \times 10^{-4}$$

$$n \geq 4899$$

5) Case of determining the fault of a class A calculator measuring volume at metering conditions

$$T = SF \text{ (significant fault)}$$

$$T = MPE / 10 = 0.7 \times 10^{-3} \times n \times s$$

$$n \geq 3500$$

CONCLUSION

For measuring systems or metering modules it is necessary to calculate the minimum test quantity for each application. The number of scale intervals which is found should be increased because the assumption "it can be assumed that the largest uncertainty component is due to the rounding of the digital scale intervals" is not true in general.

For calculators, above cases 4 and 5 correspond to the most severe conditions and it is proposed to always perform tests on quantities corresponding to 5 000 scale intervals. However in case of necessity (long tests), the appropriate number can be calculated. Note that the assumption "it can be assumed that the largest uncertainty component is due to the rounding of the digital scale intervals" is true in general for calculators.

ANNEX G

CONVERSION OF GAS MASS TO VOLUME AT BASE CONDITIONS

(Informative)

G.1 Calculation of volume at base conditions from mass

Knowing the weight or mass (w) of a quantity of gas, the equation to calculate volume at base conditions (V_b) is as follows:

$$V_b = \frac{w}{\rho_b} \quad \text{Eq. (1)}$$

Where:

w = Weight or mass of gas

V_b = Volume of gas at base conditions

ρ_b = Density of gas at base conditions

G.1.1 Calculation of volume flowrate at base conditions from mass flowrate

Knowing the weight or mass flowrate (Q_m) of a quantity of gas, the equation to calculate volume at base conditions flowrate (Q_{v_b}) is as follows:

$$Q_{v_b} = \frac{Q_m}{\rho_b} \quad \text{Eq. (1.1)}$$

Where:

Q_m = Weight or mass flowrate of gas

Q_{v_b} = Volume flowrate of gas at base conditions

ρ_b = Density of gas at base conditions

G.1.2 Typical units of measure for volume at base condition calculations

Variable	SI Units
w	kg
V_b	m^3
Q_m	kg/h
Q_{v_b}	m^3/h
ρ_b	kg/m^3

G.2 Calculation of density at base conditions using non-ideal gas law

The calculation of gas density at base conditions (ρ_b) is dictated by the non-ideal gas law. The equation is as follows:

$$\rho_b = \frac{P_b M_r}{Z_b R T_b} \quad \text{Eq. (2)}$$

Where:

ρ_b = Density of gas at base conditions

P_b = Pressure of the gas at base conditions

M_r = Molar mass of the gas

Z_b = Compressibility of the gas at base conditions

R = Universal Gas Constant

T_b = Temperature at base conditions

G.2.1 Calculation of base density using relative density

An alternate method to calculate the density of the gas at base conditions (ρ_b) is by utilizing the relative density (G_r) or specific gravity of the gas. This equation is as follows:

$$\rho_b = G_r \rho_{b(Air)} \quad \text{Eq. (2.1)}$$

Where:

ρ_b = Density of gas at base conditions

G_r = Relative density of the gas at base conditions

$\rho_{b(Air)}$ = Density of air at base conditions

G.2.2 Typical units of measure for base density calculations

Variable	SI Units
ρ_b	kg/m ³
P_b	MPa
M_r	kg/mol
Z_b	dimensionless
R	MPa.m ³ /mol.K (0.00831451)
T_b	K
G_r	dimensionless
$\rho_{b(Air)}$	kg/m ³ (1.2254 kg/m ³ at 0.101325 MPa and 288.15 K) (1.2254 kg/m ³ at 101.325 kPa and 15 °C)

G.3 Calculation variables in section 2.0 for the determination of density at base condition (ρ_b)

G.3.1 Pressure at base condition (P_b)

The pressure at base conditions is determined by contractual agreements, common units and conversions are as follows.

Unit A	Conversion (Unit A x Conversion = Unit B)	Unit B
bar	100 000	Pa
kPa	1 000	Pa
MPa	1 000 000	Pa

G.3.2 Molar weight (M_r)

Molar weight of a gas (M_r) in “kg/mol” is calculated in accordance with the following equation:

$$M_r = \sum_{i=1}^N x_i M_{r_i}$$

Where:

$M_{r(gas)}$ = Molar weight of the gas

N = Number of components in the gas mixture

i = Component number sequence, i through N

x_i = Mole fraction component number i

M_{r_i} = Molar weight of component i

As an example, the molar weight of a three component mixture of natural gas containing 90% Methane, 5% Carbon Dioxide, and 5% Nitrogen would be calculated as follows.

Natural Gas Component	Molar Weight kg/mol		Molar Fraction (%)		Product Molar Weight and Fraction
Methane	16.043	X	0.900	=	14.439
N ₂	28.013	X	0.050	=	1.401
CO ₂	44.010	X	0.050	=	2.201
Ethane	30.170	X	0.000	=	0.000
Propane	44.097	X	0.000	=	0.000
I-Butane	58.123	X	0.000	=	0.000
N-Butane	58.123	X	0.000	=	0.000
I-Pentane	72.150	X	0.000	=	0.000
N-Pentane	72.150	X	0.000	=	0.000
N-Hexane	86.177	X	0.000	=	0.000
N-Heptane	100.204	X	0.000	=	0.000
N-Octane	114.231	X	0.000	=	0.000
N-Nonane	128.258	X	0.000	=	0.000
$M_{r(gas)} = (\text{Sum of Products})$					18.040

G.3.3 Compressibility factor at base conditions (Z_b)

The calculation of base compressibility can be accomplished by methods called out in the following measurement references.

International Organization for Standardization, ISO 6976 - Natural Gas Calculation of Calorific Values, Density, Relative Density, and Wobbe Index from Composition

Keeping the following national examples to be decided by the BIML

Any other tables accepted for use at National level, *for example in the United States:*

American Gas Association, Report Number 8 - Compressibility Factors of Natural Gas and other Related Hydrocarbon Gases

Gas Processors Association, GPA STD 2145 - Table of Physical Constants for Hydrocarbons and other Compounds of Interest to the Natural Gas Industry

ANNEX H
(Informative)

BIBLIOGRAPHY

- [1] International Vocabulary of Basic and General Terms in Metrology (VIM). BIPM, IEC, IFCC, ISO, IUPAC, IUPAP and OIML. International Organization for Standardization, Geneva, 1993
- [2] International vocabulary of terms in legal metrology (VIML). OIML, Paris, 2000
- [3] Bureau International des Poids et Mesures (1998): The International System of Units (SI), Organisation Intergouvernementale de la Convention du Mètre, 7th edition, BIPM, Paris, 1998
- [4] Bureau International des Poids et Mesures (2000): The International System of Units, Supplement 2000: addenda and corrigenda to the 7th edition (1998), BIPM, Paris, 2000
- [5] OIML International Document D 2: Legal units of measurement, OIML, Paris, 1999
- [6] OIML International Document D 11: General Requirements for electronic measuring instruments. OIML, Paris, 2004
- [7] Guide to the expression of uncertainty in measurement. BIPM, IEC, IFCC, ISO, IUPAC, IUPAP and OIML. International Organization for Standardization, Geneva, 1995
- [8] OIML Recommendation R 137-1: Gas meters – Part 1: Requirements, OIML, Paris, 2006
- [9] ISO 12213-1 (2006): Natural gas — Calculation of compression factor — Part 1: Introduction and guidelines, ISO, Geneva, 2006
- [10] ISO 12213-2 (2006): Natural gas — Calculation of compression factor — Part 2: Calculation using molar-composition analysis, ISO, Geneva, 2006
- [11] ISO 12213-3 (2006): Natural gas — Calculation of compression factor — Part 3: Calculation using physical properties, ISO, Geneva, 2006
- [12] ISO 6976 (1995) with corrigendum 1 (1997), corrigendum 2 (1997) and corrigendum 3 (1999): Natural gas, calculation of calorific values, density, relative density, Wobbe index from composition, ISO, Geneva, 1995.
- [13] IEC 60068-2-1 (1990-05) with amendments 1 (1993-02) and 2 (1994-06) Environmental testing, Part2: Tests, Test A: Cold
- [14] IEC 60068-2-2 (1974-01), with amendments 1 (1993-02) and 2 (1994-05) Environmental testing Part2: Tests. Test B: Dry heat
- [15] IEC 60068-3-1 (1974-01) with amendment 1 (1978-01) Environmental testing - Part 3: Background information - Section One: Cold and dry heat tests
- [16] IEC 60068-3-4 (2001-08) Environmental testing - Part 3-4: Supporting documentation and guidance - Damp heat tests
- [17] IEC 60068-2-30 (2005-08) Environmental testing Part 2: Tests. Test Db and guidance: Damp heat, cyclic (12 + 12-hour cycle)
- [18] IEC 60068-2-31 (1969-01) with amendment 1 (1982-01) Environmental testing Part 2: Tests Test Ec: Drop and topple, primarily for equipment-type specimens
- [19] IEC 60068-2-47 (2005-04) Environmental testing Part 2-47: Test methods, Mounting of components, equipment and other articles for vibration, impact and similar dynamic tests
- [20] IEC 60068-2-64 (1993-05), with Corrigendum 1(1993-10) Environmental testing - Part 2: Test methods, Test Fh: Vibration, broad-band random (digital control) and guidance
- [21] IEC 60068-2-78 (2001-08) Environmental testing - Part 2-78: Tests - Test Cab: Damp heat, steady state
- [22] IEC 60654-2 (1979-01) with amendment 1 (1992-09) Operating conditions for industrial-process measurement and control equipment. Part 2: Power
- [23] IEC 61000-2-2 (2002-03) Electromagnetic compatibility (EMC) - Part 2-2: Environment - Compatibility levels for low-frequency conducted disturbances and signalling in public low-voltage power supply systems
- [24] IEC 61000-4-1 (2006-10) Electromagnetic compatibility (EMC) - Part 4-1: Testing and measurement techniques - Overview of IEC 61000-4 series
- [25] IEC 61000-4-2 (1995-01) with amendment 1 (1998-01) and amendment 2 (2000-11) Basic EMC Publication Electromagnetic compatibility (EMC) Part 4: Testing and measurement techniques, Section 2: Electrostatic discharge immunity test. Consolidated Edition: IEC 61000-4-2 (2001-04) Ed. 1.2

- [26] IEC 61000-4-3 (2006-02) Electromagnetic compatibility (EMC)L: Part 4: Testing and measurement techniques, Section 3: Radiated, radio-frequency, electromagnetic field immunity test
- [27] IEC 61000-4-4 (2004-07) with corrigendum 1 (2006-08) Electromagnetic compatibility (EMC) - Part 4: Testing and measurement techniques - Section 4: Electrical fast transient/burst immunity test. Basic EMC Publication
- [28] IEC 61000-4-5 (2005-11) Electromagnetic compatibility (EMC)- Part 4-5: Testing and measurement techniques - Surge immunity test
- [29] IEC 61000-4-6 (2003-05) with amendment 1 (2004-10) and amendment 2 (2006-03) Electromagnetic compatibility (EMC): Part 4: Testing and measurement techniques, Section 6: Immunity to conducted disturbances, induced by radio-frequency fields. Consolidated Edition: IEC 61000-4-6 (2006-05) Ed. 2.2
- [30] IEC 61000-4-11 (2004-03) - Part 4-11: Testing and measuring techniques - Voltage dips, short interruptions and voltage variations immunity tests
- [31] IEC 61000-6-1 (2005-03) Electromagnetic compatibility (EMC) - Part 6: Generic standards - Section 1: Immunity for residential, commercial and light-industrial environments
- [32] IEC 61000-6-2 (2005-01) Electromagnetic compatibility (EMC) - Part 6-2: Generic standards - Immunity for industrial environments